


## BMID Turbidity July 2020

(Single Point Daily Sampling with Inline Hach 1720c)

**WQA**

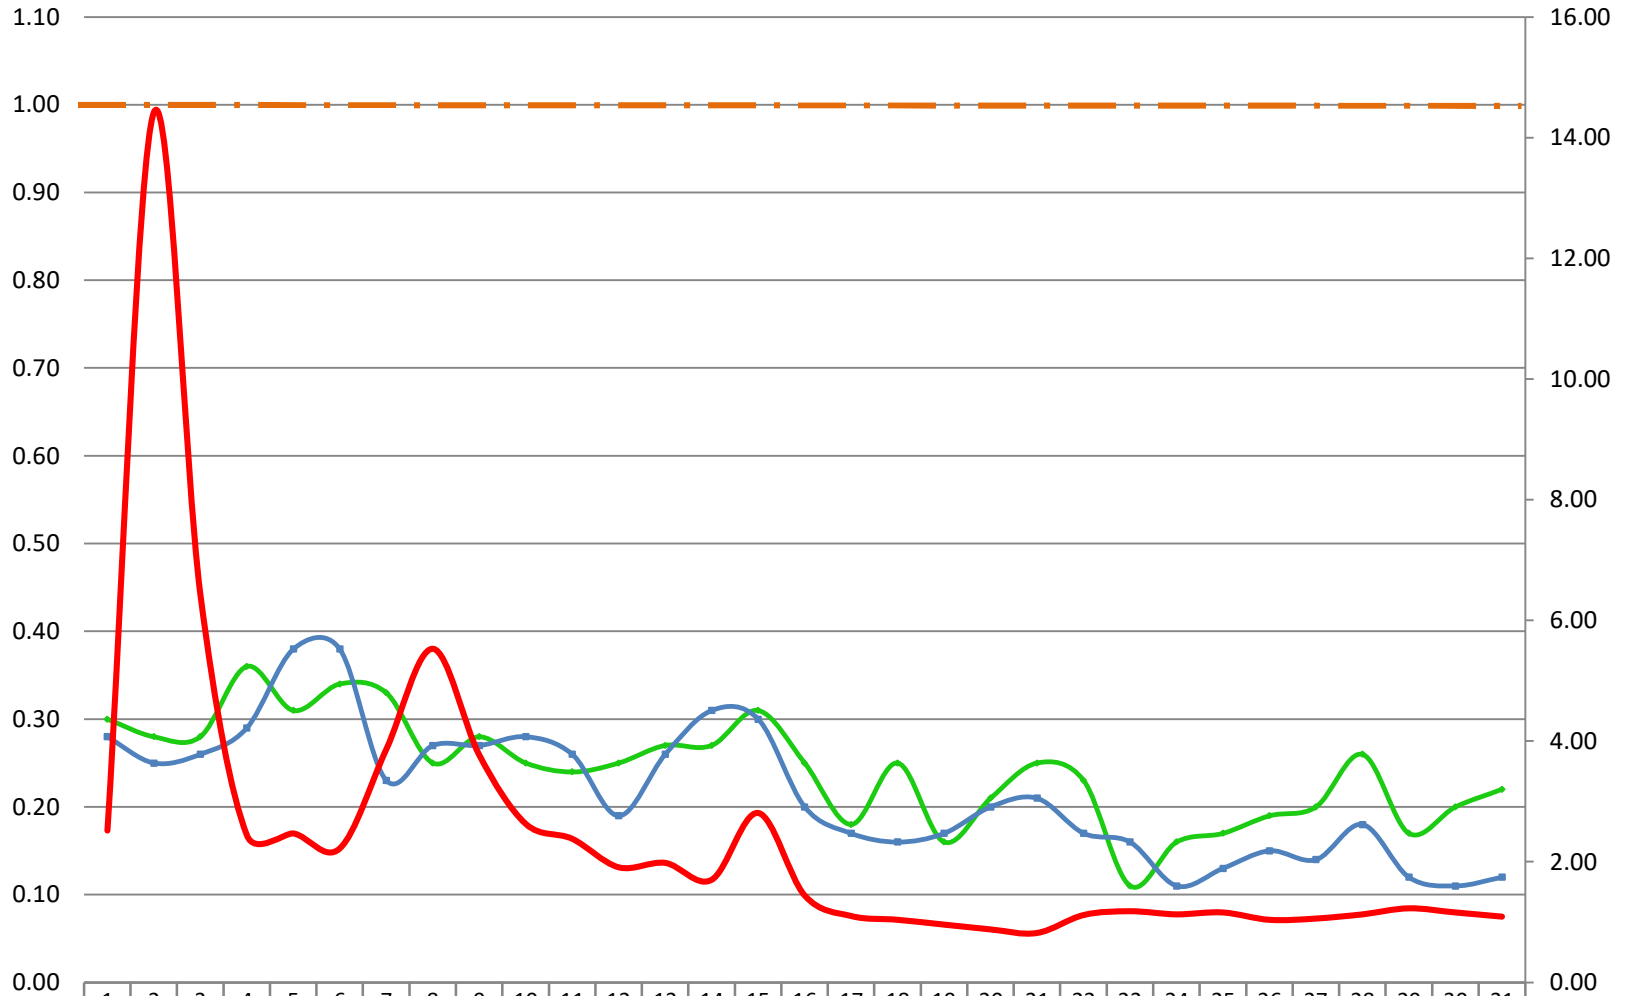

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
<span style="color: green;">—</span> Distribution Intake	0.30	0.28	0.28	0.36	0.31	0.34	0.33	0.25	0.28	0.25	0.24	0.25	0.27	0.27	0.31	0.25	0.18	0.25	0.16	0.21	0.25	0.23	0.11	0.16	0.17	0.19	0.20	0.26	0.17	0.20	0.22
<span style="color: blue;">—</span> Booster #1	0.28	0.25	0.26	0.29	0.38	0.38	0.23	0.27	0.27	0.28	0.26	0.19	0.26	0.31	0.30	0.20	0.17	0.16	0.17	0.20	0.21	0.17	0.16	0.11	0.13	0.15	0.14	0.18	0.12	0.11	0.12
<span style="color: red;">—</span> Mission Creek Intake	2.52	14.4	6.45	2.44	2.47	2.22	3.87	5.53	3.77	2.63	2.38	1.91	1.98	1.70	2.81	1.44	1.10	1.04	0.96	0.88	0.82	1.12	1.18	1.13	1.16	1.04	1.06	1.13	1.23	1.16	1.09