



## CERTIFICATE OF ANALYSIS

**REPORTED TO** Black Mountain Irrigation District  
285 Gray Avenue  
KELOWNA, BC V1X 1W8

**ATTENTION** Robert Hrasko

**PO NUMBER**  
**PROJECT** General Potability  
**PROJECT INFO**

**WORK ORDER** 21G3046

**RECEIVED / TEMP** 2021-07-26 15:11 / 21.0°C  
**REPORTED** 2021-08-03 13:11  
**COC NUMBER** B095584

### Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO/IEC 17025:2017 for specific tests listed in the scope of accreditation approved by CALA.

#### *Big Picture Sidekicks*



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

#### *We've Got Chemistry*



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

#### *Ahead of the Curve*



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.


If you have any questions or concerns, please contact me at [bwhitehead@caro.ca](mailto:bwhitehead@caro.ca)

#### Authorized By:

Brent Whitehead  
Client Scientist - Team Lead

1-888-311-8846 | [www.caro.ca](http://www.caro.ca)

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7 | #108 4475 Wayburne Drive Burnaby, BC V5G 4X4

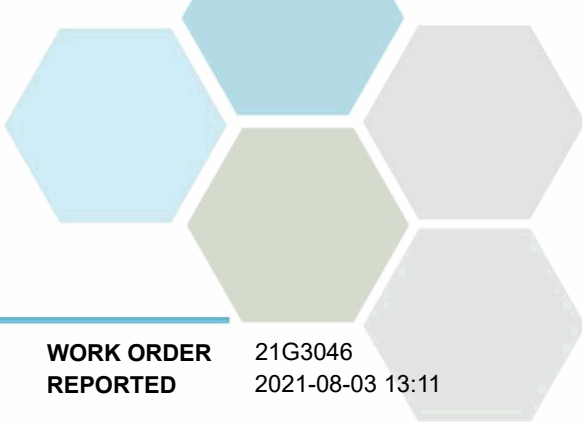

# TEST RESULTS

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability

**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

Analyte	Result	RL	Units	Analyzed	Qualifier
---------	--------	----	-------	----------	-----------

**Well #5 (21G3046-01) | Matrix: Water | Sampled: 2021-07-26 14:15**

**Anions**

Chloride	17.4	0.10	mg/L	2021-07-27	
Fluoride	0.17	0.10	mg/L	2021-07-27	
Nitrate (as N)	6.41	0.010	mg/L	2021-07-27	
Nitrite (as N)	< 0.010	0.010	mg/L	2021-07-27	
Sulfate	29.5	1.0	mg/L	2021-07-27	

**Calculated Parameters**


Hardness, Total (as CaCO3)	265	0.500	mg/L	N/A	
Langelier Index	0.8	-5.0		2021-07-30	
Solids, Total Dissolved	328	1.00	mg/L	N/A	

**General Parameters**

Alkalinity, Total (as CaCO3)	236	1.0	mg/L	2021-07-27	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Bicarbonate (as CaCO3)	236	1.0	mg/L	2021-07-27	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Colour, True	< 5.0	5.0	CU	2021-07-28	
Conductivity (EC)	547	2.0	µS/cm	2021-07-27	
Cyanide, Total	< 0.0020	0.0020	mg/L	2021-07-29	
pH	7.94	0.10	pH units	2021-07-27	HT2
Temperature, at pH	22.1		°C	2021-07-27	HT2
Turbidity	< 0.10	0.10	NTU	2021-07-27	

**Total Metals**

Aluminum, total	< 0.0050	0.0050	mg/L	2021-07-30	
Antimony, total	< 0.00020	0.00020	mg/L	2021-07-30	
Arsenic, total	< 0.00050	0.00050	mg/L	2021-07-30	
Barium, total	0.0222	0.0050	mg/L	2021-07-30	
Boron, total	< 0.0500	0.0500	mg/L	2021-07-30	
Cadmium, total	< 0.000010	0.000010	mg/L	2021-07-30	
Calcium, total	77.7	0.20	mg/L	2021-07-30	
Chromium, total	0.00063	0.00050	mg/L	2021-07-30	
Cobalt, total	< 0.00010	0.00010	mg/L	2021-07-30	
Copper, total	0.00592	0.00040	mg/L	2021-07-30	
Iron, total	< 0.010	0.010	mg/L	2021-07-30	
Lead, total	0.00025	0.00020	mg/L	2021-07-30	
Magnesium, total	17.1	0.010	mg/L	2021-07-30	
Manganese, total	< 0.00020	0.00020	mg/L	2021-07-30	
Mercury, total	< 0.000010	0.000010	mg/L	2021-07-30	
Molybdenum, total	0.00177	0.00010	mg/L	2021-07-30	
Nickel, total	< 0.00040	0.00040	mg/L	2021-07-30	
Potassium, total	2.37	0.10	mg/L	2021-07-30	
Selenium, total	0.00165	0.00050	mg/L	2021-07-30	

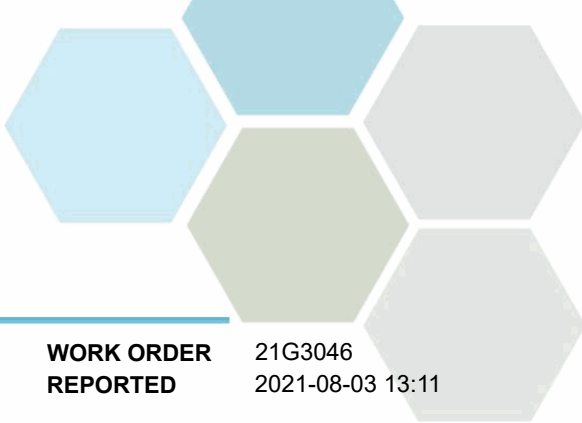

# TEST RESULTS

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability

**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

Analyte	Result	RL	Units	Analyzed	Qualifier
---------	--------	----	-------	----------	-----------

**Well #5 (21G3046-01) | Matrix: Water | Sampled: 2021-07-26 14:15, Continued**

**Total Metals, Continued**

Sodium, total	11.9	0.10	mg/L	2021-07-30	
Strontium, total	0.329	0.0010	mg/L	2021-07-30	
Uranium, total	0.00244	0.000020	mg/L	2021-07-30	
Zinc, total	< 0.0040	0.0040	mg/L	2021-07-30	

**Well #6 (21G3046-02) | Matrix: Water | Sampled: 2021-07-26 14:15**

**Anions**

Chloride	6.20	0.10	mg/L	2021-07-27	
Fluoride	0.17	0.10	mg/L	2021-07-27	
Nitrate (as N)	1.56	0.010	mg/L	2021-07-27	
Nitrite (as N)	< 0.010	0.010	mg/L	2021-07-27	
Sulfate	24.5	1.0	mg/L	2021-07-27	

**Calculated Parameters**


Hardness, Total (as CaCO3)	216	0.500	mg/L	N/A	
Langelier Index	0.7	-5.0		2021-07-30	
Solids, Total Dissolved	256	1.00	mg/L	N/A	

**General Parameters**

Alkalinity, Total (as CaCO3)	211	1.0	mg/L	2021-07-27	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Bicarbonate (as CaCO3)	211	1.0	mg/L	2021-07-27	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Colour, True	< 5.0	5.0	CU	2021-07-28	
Conductivity (EC)	429	2.0	µS/cm	2021-07-27	
Cyanide, Total	< 0.0020	0.0020	mg/L	2021-07-29	
pH	7.96	0.10	pH units	2021-07-27	HT2
Temperature, at pH	22.5		°C	2021-07-27	HT2
Turbidity	< 0.10	0.10	NTU	2021-07-27	

**Total Metals**

Aluminum, total	< 0.0050	0.0050	mg/L	2021-07-30	
Antimony, total	< 0.00020	0.00020	mg/L	2021-07-30	
Arsenic, total	< 0.00050	0.00050	mg/L	2021-07-30	
Barium, total	0.0134	0.0050	mg/L	2021-07-30	
Boron, total	< 0.0500	0.0500	mg/L	2021-07-30	
Cadmium, total	< 0.000010	0.000010	mg/L	2021-07-30	
Calcium, total	64.1	0.20	mg/L	2021-07-30	
Chromium, total	< 0.00050	0.00050	mg/L	2021-07-30	
Cobalt, total	< 0.00010	0.00010	mg/L	2021-07-30	
Copper, total	0.00048	0.00040	mg/L	2021-07-30	
Iron, total	< 0.010	0.010	mg/L	2021-07-30	

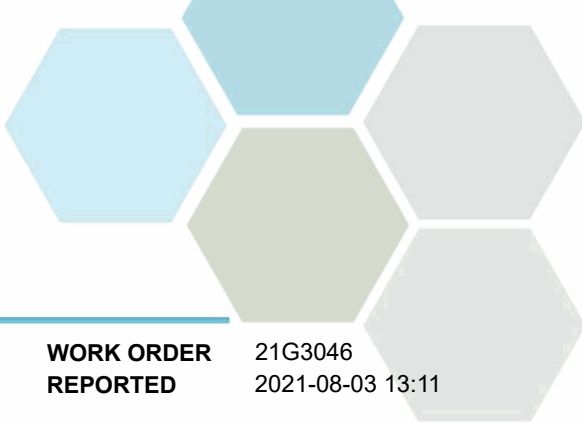

# TEST RESULTS

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability

**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

Analyte	Result	RL	Units	Analyzed	Qualifier
---------	--------	----	-------	----------	-----------

**Well #6 (21G3046-02) | Matrix: Water | Sampled: 2021-07-26 14:15, Continued**

**Total Metals, Continued**

Lead, total	< 0.00020	0.00020	mg/L	2021-07-30	
Magnesium, total	13.6	0.010	mg/L	2021-07-30	
Manganese, total	0.00033	0.00020	mg/L	2021-07-30	
Mercury, total	< 0.000010	0.000010	mg/L	2021-07-30	
Molybdenum, total	0.00151	0.00010	mg/L	2021-07-30	
Nickel, total	< 0.00040	0.00040	mg/L	2021-07-30	
Potassium, total	2.01	0.10	mg/L	2021-07-30	
Selenium, total	0.00114	0.00050	mg/L	2021-07-30	
Sodium, total	9.97	0.10	mg/L	2021-07-30	
Strontium, total	0.258	0.0010	mg/L	2021-07-30	
Uranium, total	0.000866	0.000020	mg/L	2021-07-30	
Zinc, total	< 0.0040	0.0040	mg/L	2021-07-30	

**Pearson School (21G3046-03) | Matrix: Water | Sampled: 2021-07-26 11:13**

**Anions**

Chloride	9.82	0.10	mg/L	2021-07-27	
Fluoride	< 0.10	0.10	mg/L	2021-07-27	
Nitrate (as N)	< 0.010	0.010	mg/L	2021-07-27	
Nitrite (as N)	< 0.010	0.010	mg/L	2021-07-27	
Sulfate	3.5	1.0	mg/L	2021-07-27	

**Calculated Parameters**


Hardness, Total (as CaCO3)	35.5	0.500	mg/L	N/A	
Langelier Index	-1.4	-5.0		2021-07-30	
Solids, Total Dissolved	51.8	1.00	mg/L	N/A	

**General Parameters**

Alkalinity, Total (as CaCO3)	32.5	1.0	mg/L	2021-07-27	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Bicarbonate (as CaCO3)	32.5	1.0	mg/L	2021-07-27	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2021-07-27	
Colour, True	< 5.0	5.0	CU	2021-07-28	
Conductivity (EC)	96.5	2.0	µS/cm	2021-07-27	
Cyanide, Total	< 0.0020	0.0020	mg/L	2021-07-29	
pH	7.53	0.10	pH units	2021-07-27	HT2
Temperature, at pH	22.3		°C	2021-07-27	HT2
Turbidity	0.36	0.10	NTU	2021-07-27	

**Total Metals**

Aluminum, total	0.234	0.0050	mg/L	2021-07-30	
Antimony, total	< 0.00020	0.00020	mg/L	2021-07-30	
Arsenic, total	< 0.00050	0.00050	mg/L	2021-07-30	

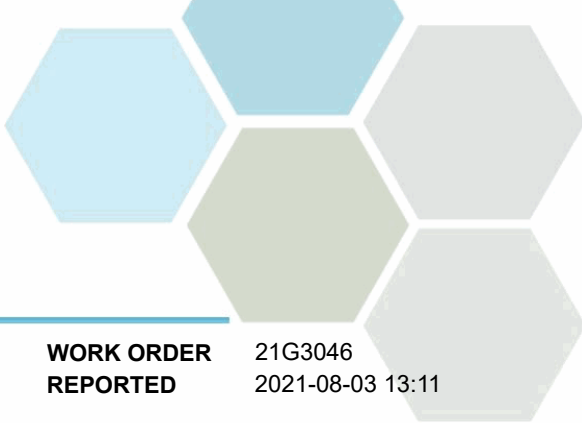


# TEST RESULTS

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability

**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

Analyte	Result	RL	Units	Analyzed	Qualifier
<b>Pearson School (21G3046-03)   Matrix: Water   Sampled: 2021-07-26 11:13, Continued</b>					
<i>Total Metals, Continued</i>					
Barium, total	<b>0.0085</b>	0.0050	mg/L	2021-07-30	
Boron, total	< 0.0500	0.0500	mg/L	2021-07-30	
Cadmium, total	< 0.000010	0.000010	mg/L	2021-07-30	
Calcium, total	<b>10.1</b>	0.20	mg/L	2021-07-30	
Chromium, total	< 0.00050	0.00050	mg/L	2021-07-30	
Cobalt, total	< 0.00010	0.00010	mg/L	2021-07-30	
Copper, total	<b>0.00388</b>	0.00040	mg/L	2021-07-30	
Iron, total	<b>0.012</b>	0.010	mg/L	2021-07-30	
Lead, total	< 0.00020	0.00020	mg/L	2021-07-30	
Magnesium, total	<b>2.51</b>	0.010	mg/L	2021-07-30	
Manganese, total	<b>0.00549</b>	0.00020	mg/L	2021-07-30	
Mercury, total	< 0.000010	0.000010	mg/L	2021-07-30	
Molybdenum, total	<b>0.00059</b>	0.00010	mg/L	2021-07-30	
Nickel, total	< 0.00040	0.00040	mg/L	2021-07-30	
Potassium, total	<b>0.90</b>	0.10	mg/L	2021-07-30	
Selenium, total	< 0.00050	0.00050	mg/L	2021-07-30	
Sodium, total	<b>5.23</b>	0.10	mg/L	2021-07-30	
Strontium, total	<b>0.0527</b>	0.0010	mg/L	2021-07-30	
Uranium, total	<b>0.000035</b>	0.000020	mg/L	2021-07-30	
Zinc, total	< 0.0040	0.0040	mg/L	2021-07-30	

**Sample Qualifiers:**  
HT2 The 15 minute recommended holding time (from sampling to analysis) has been exceeded - field analysis is recommended.

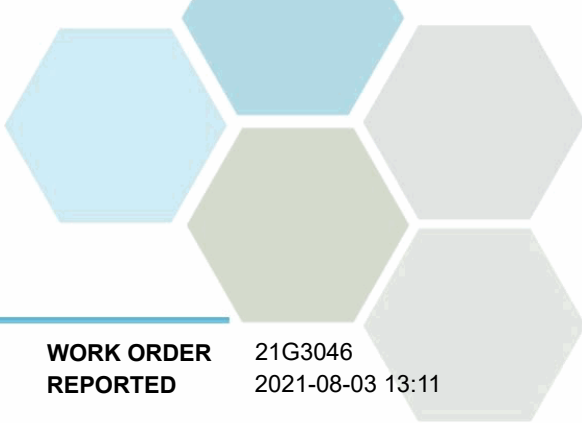

## APPENDIX 1: SUPPORTING INFORMATION

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability


**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

Analysis Description	Method Ref.	Technique	Accredited	Location
Alkalinity in Water	SM 2320 B* (2017)	Titration with H2SO4	✓	Kelowna
Anions in Water	SM 4110 B (2017)	Ion Chromatography	✓	Kelowna
Colour, True in Water	SM 2120 C (2017)	Spectrophotometry (456 nm)	✓	Kelowna
Conductivity in Water	SM 2510 B (2017)	Conductivity Meter	✓	Kelowna
Cyanide, SAD in Water	ASTM D7511-12	Flow Injection with In-Line UV Digestion and Amperometry	✓	Kelowna
Hardness in Water	SM 2340 B* (2017)	Calculation: 2.497 [total Ca] + 4.118 [total Mg] (Est)	✓	N/A
Langelier Index in Water	SM 2330 B (2017)	Calculation		N/A
Mercury, total in Water	EPA 245.7*	BrCl2 Oxidation / Cold Vapor Atomic Fluorescence Spectrometry (CVAFS)	✓	Richmond
pH in Water	SM 4500-H+ B (2017)	Electrometry	✓	Kelowna
Solids, Total Dissolved in Water	SM 1030 E (2017)	SM 1030 E (2011)		N/A
Total Metals in Water	EPA 200.2 / EPA 6020B	HNO3+HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	✓	Richmond
Turbidity in Water	SM 2130 B (2017)	Nephelometry	✓	Kelowna

*Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method*

### Glossary of Terms:

RL	Reporting Limit (default)
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
°C	Degrees Celcius
CU	Colour Units (referenced against a platinum cobalt standard)
mg/L	Milligrams per litre
NTU	Nephelometric Turbidity Units
pH units	pH < 7 = acidic, pH > 7 = basic
µS/cm	Microsiemens per centimetre
ASTM	ASTM International Test Methods
EPA	United States Environmental Protection Agency Test Methods
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

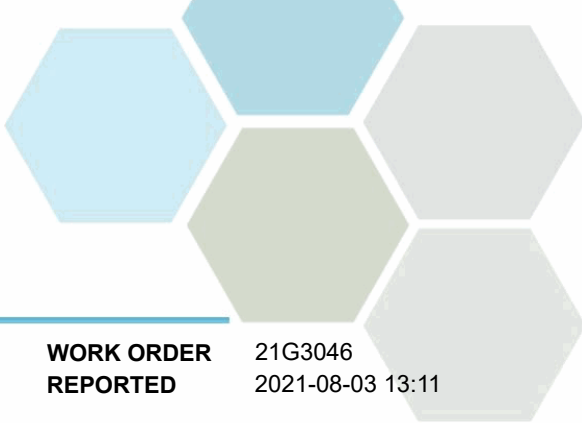

## APPENDIX 1: SUPPORTING INFORMATION

**REPORTED TO PROJECT** Black Mountain Irrigation District  
General Potability

**WORK ORDER REPORTED** 21G3046  
2021-08-03 13:11

**General Comments:**

The results in this report apply to the samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Samples will be disposed of 30 days after the test report has been issued or once samples expire, whichever comes first. Longer hold is possible if agreed to in writing. The quality control (QC) data is available upon request

Results in **Bold** indicate values that are above CARO's method reporting limits. Any results that are above regulatory limits are highlighted **red**. Please note that results will only be highlighted red if the regulatory limits are included on the CARO report. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method uncertainty or regulatory limits to be included on your report, please contact your Account Manager: [bwhitehead@caro.ca](mailto:bwhitehead@caro.ca)

*Please note any regulatory guidelines applied to this report are added as a convenience to the client, at their request, to help provide some initial context to analytical results obtained. Although CARO makes every effort to ensure accuracy of the associated regulatory guideline(s) applied, the guidelines applied cannot be assumed to be correct due to a variety of factors and as such CARO Analytical Services assumes no liability or responsibility for the use of those guidelines to make any decisions. The original source of the regulation should be verified and a review of the guideline(s) should be validated as correct in order to make any decisions arising from the comparison of the analytical data obtained to the relevant regulatory guideline for one's particular circumstances. Further, CARO Analytical Services assumes no liability or responsibility for any loss attributed from the use of these guidelines in any way.*