


# BMID Turbidity October 2021

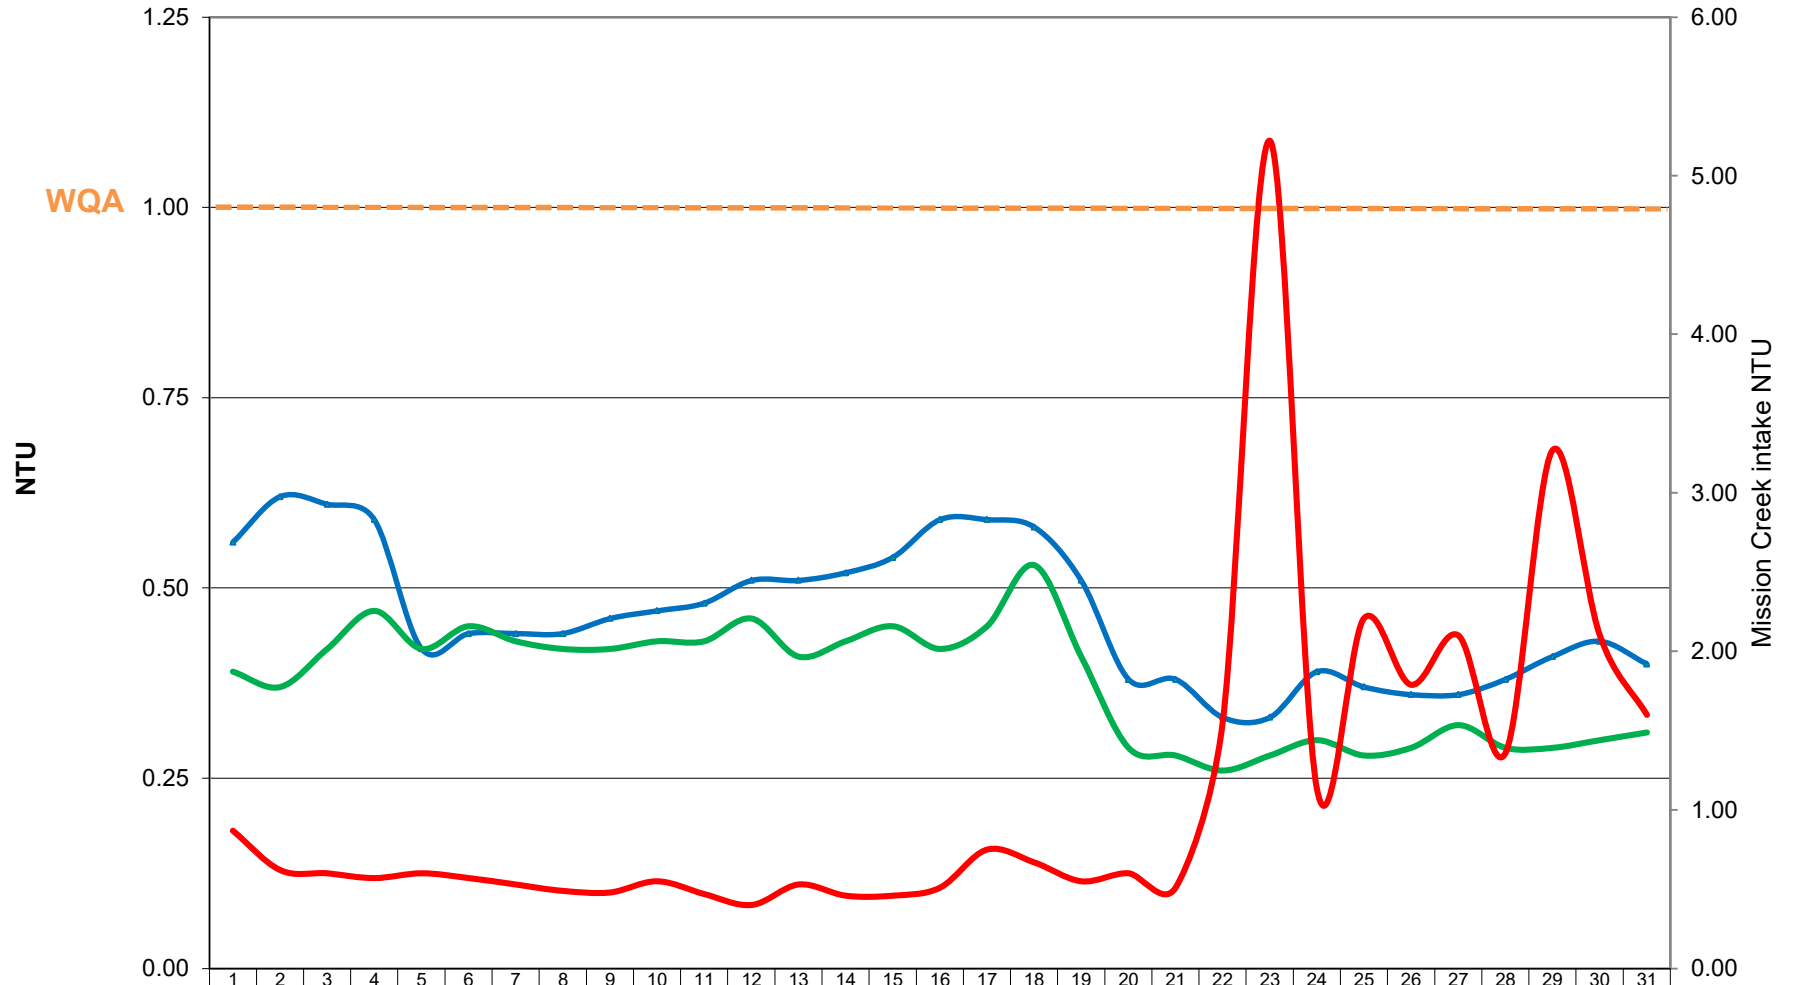

— Distribution Intake Booster#1- First User	0.56	0.62	0.61	0.59	0.42	0.44	0.44	0.44	0.46	0.47	0.48	0.51	0.51	0.52	0.54	0.59	0.59	0.58	0.51	0.38	0.38	0.33	0.33	0.39	0.37	0.36	0.36	0.38	0.41	0.43	0.40
— Booster#1- First User	0.39	0.37	0.42	0.47	0.42	0.45	0.43	0.42	0.42	0.43	0.43	0.46	0.41	0.43	0.45	0.42	0.45	0.53	0.41	0.29	0.28	0.26	0.28	0.30	0.28	0.29	0.32	0.29	0.29	0.30	0.31
— Mission Creek Intake	0.87	0.62	0.60	0.57	0.60	0.57	0.53	0.49	0.48	0.55	0.47	0.40	0.53	0.46	0.46	0.51	0.75	0.67	0.55	0.60	0.51	1.55	5.22	1.13	2.21	1.79	2.10	1.36	3.27	2.10	1.60

Date