


Black Mountain Irrigation District Turbidity Monitoring

BMID Turbidity January 2015

(Single Point Daily Sampling with Inline Hach 1720c)

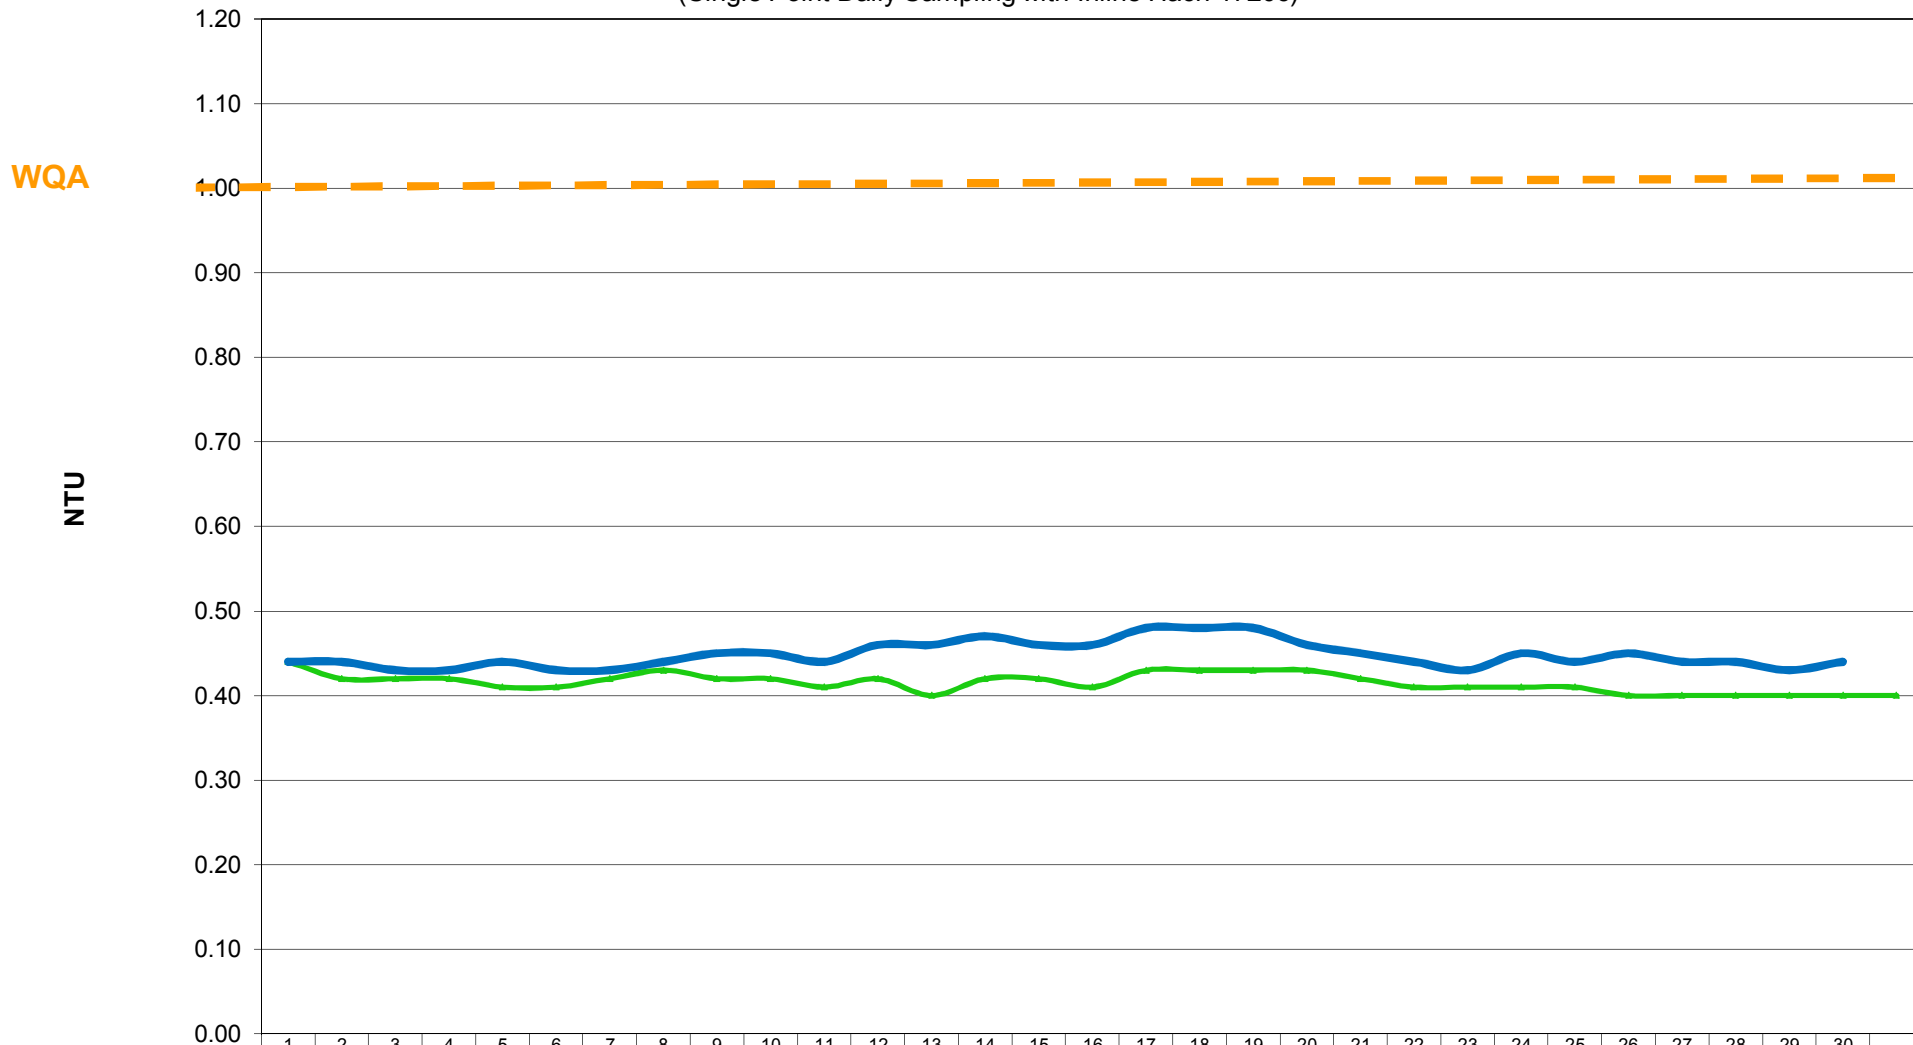

—	Intake	0.44	0.42	0.42	0.42	0.41	0.41	0.42	0.43	0.42	0.42	0.41	0.42	0.40	0.42	0.42	0.41	0.43	0.43	0.43	0.43	0.42	0.41	0.41	0.41	0.41	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40
—	Booster#1- First User	0.44	0.44	0.43	0.43	0.44	0.43	0.43	0.44	0.45	0.45	0.44	0.46	0.46	0.47	0.46	0.46	0.48	0.48	0.48	0.46	0.45	0.44	0.43	0.45	0.44	0.45	0.44	0.44	0.44	0.44	0.43	0.44	0.44	0.44

Date