


Black Mountain Irrigation District Turbidity Monitoring

BMID Turbidity August 2015

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

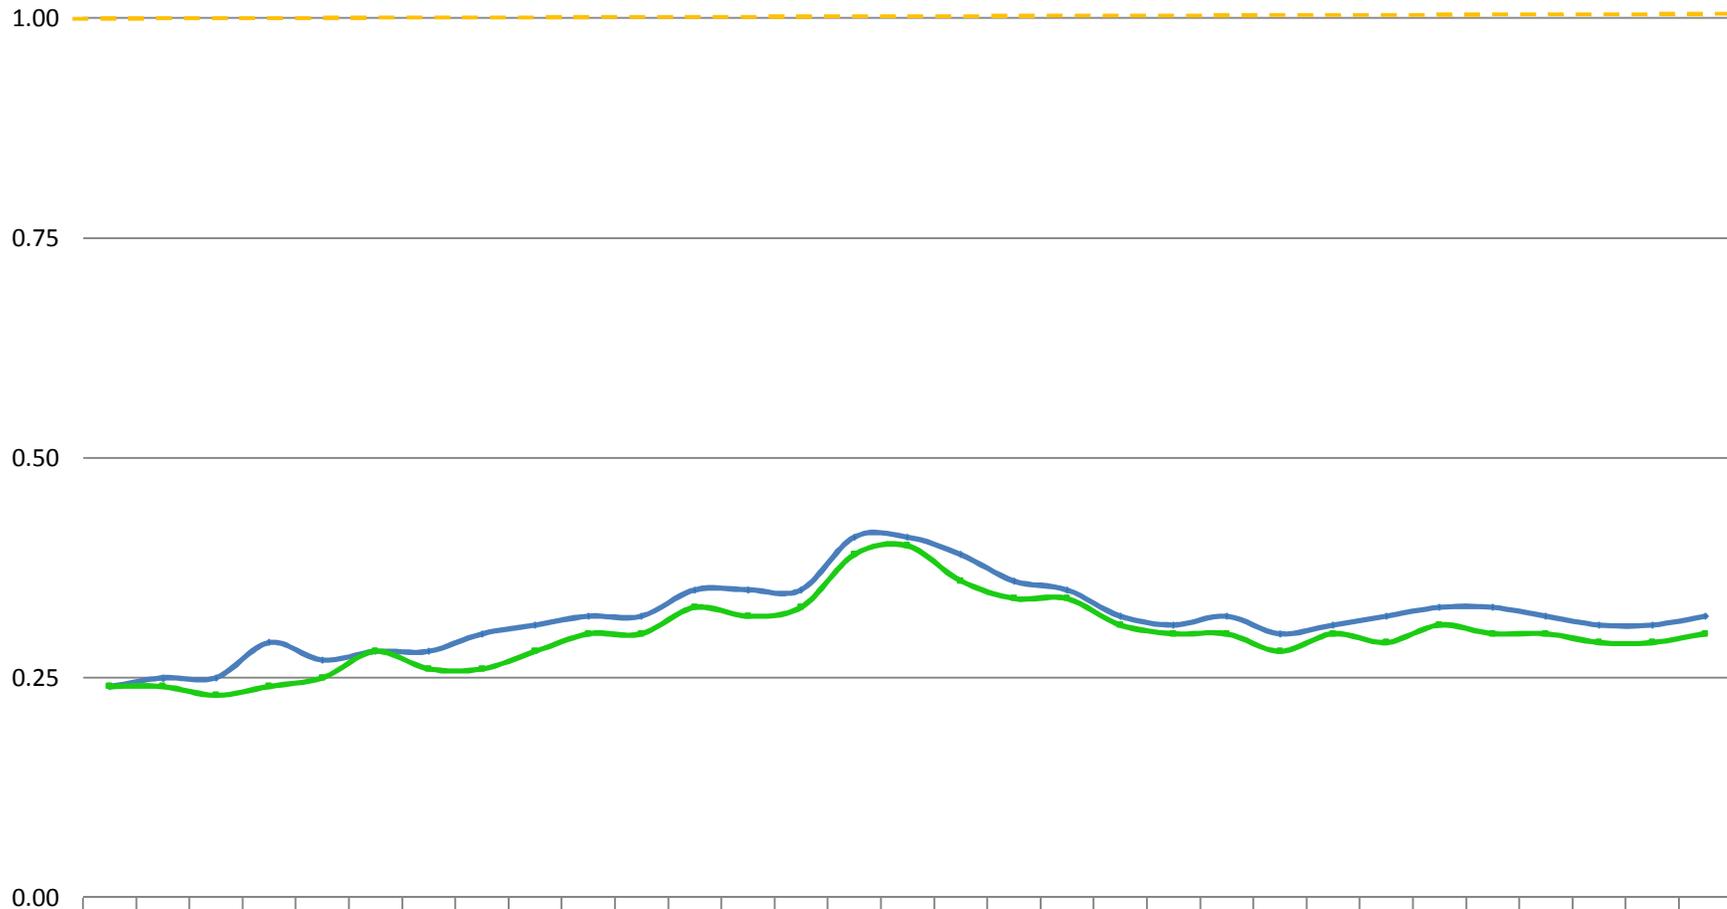

| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|-----------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Intake | 0.24 | 0.25 | 0.25 | 0.29 | 0.27 | 0.28 | 0.28 | 0.30 | 0.31 | 0.32 | 0.32 | 0.35 | 0.35 | 0.35 | 0.41 | 0.41 | 0.39 | 0.36 | 0.35 | 0.32 | 0.31 | 0.32 | 0.30 | 0.31 | 0.32 | 0.33 | 0.33 | 0.32 | 0.31 | 0.31 | 0.32 |
| Booster#1- First User | 0.24 | 0.24 | 0.23 | 0.24 | 0.25 | 0.28 | 0.26 | 0.26 | 0.28 | 0.30 | 0.30 | 0.33 | 0.32 | 0.33 | 0.39 | 0.40 | 0.36 | 0.34 | 0.34 | 0.31 | 0.30 | 0.30 | 0.28 | 0.30 | 0.29 | 0.31 | 0.30 | 0.30 | 0.29 | 0.29 | 0.30 |

—●— Intake
 —●— Booster#1- First User