


Black Mountain Irrigation District Turbidity Monitoring

BMID Turbidity August 2012

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

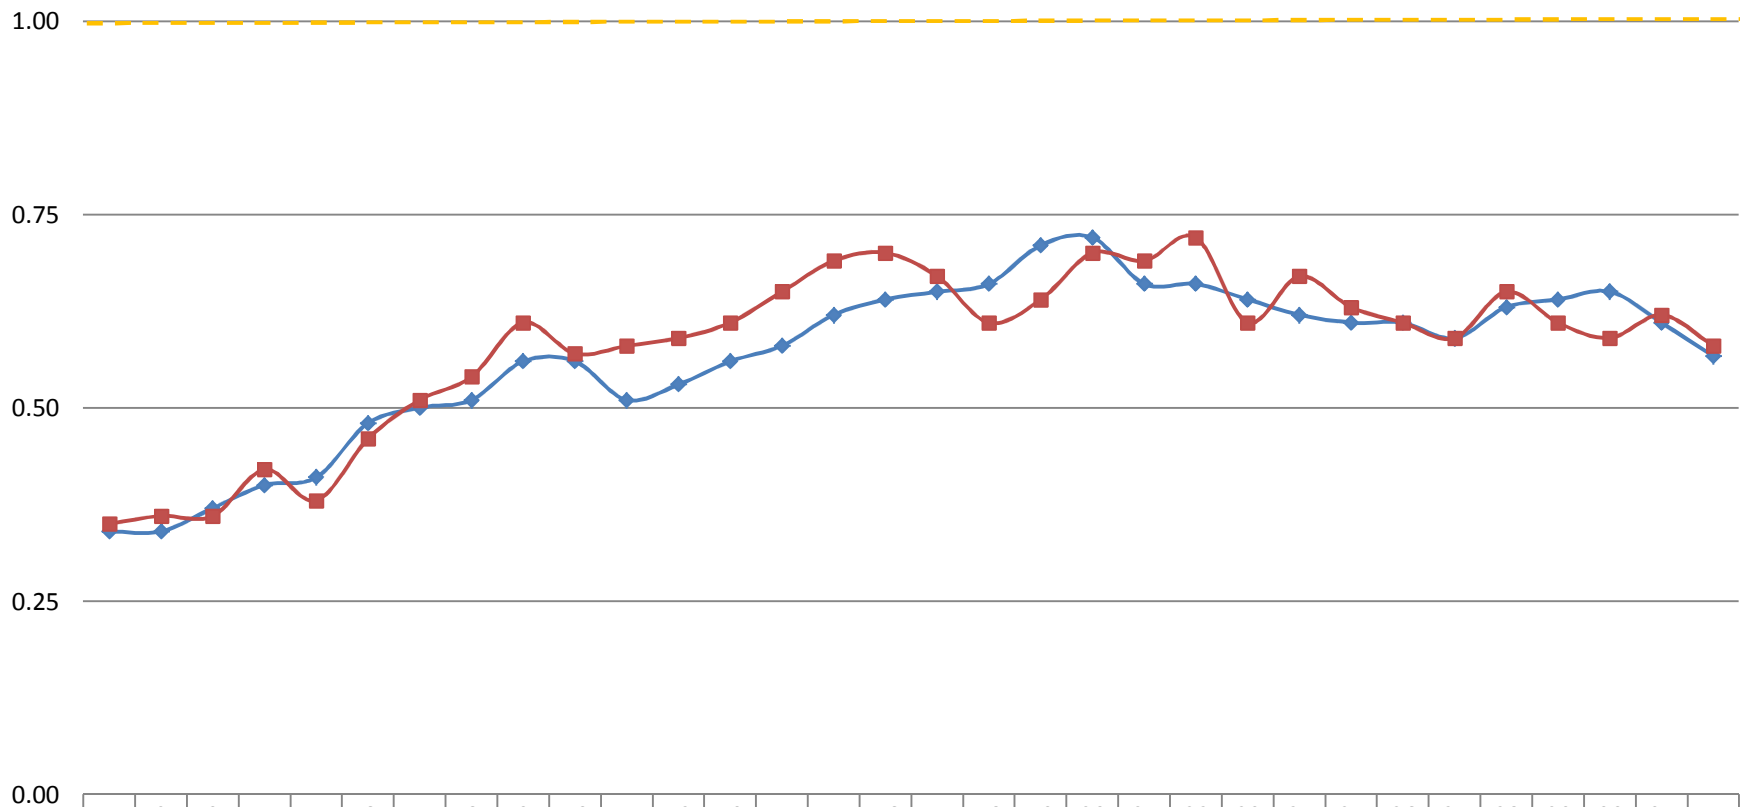

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Avg
Intake	0.3	0.3	0.3	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.7	0.7	0.6	0.6	0.6	0.6	0.6	0.6	0.5	0.6	0.6	0.6	0.6	0.5
Booster #1	0.3	0.3	0.3	0.4	0.3	0.4	0.5	0.5	0.6	0.5	0.5	0.5	0.6	0.6	0.6	0.7	0.6	0.6	0.6	0.7	0.6	0.7	0.6	0.6	0.6	0.6	0.5	0.6	0.6	0.5	0.6	0.5

◆ Intake ■ Booster #1