


BMID Turbidity December 2021

Single Point Daily Sampling with Inline Hach)
(1720c

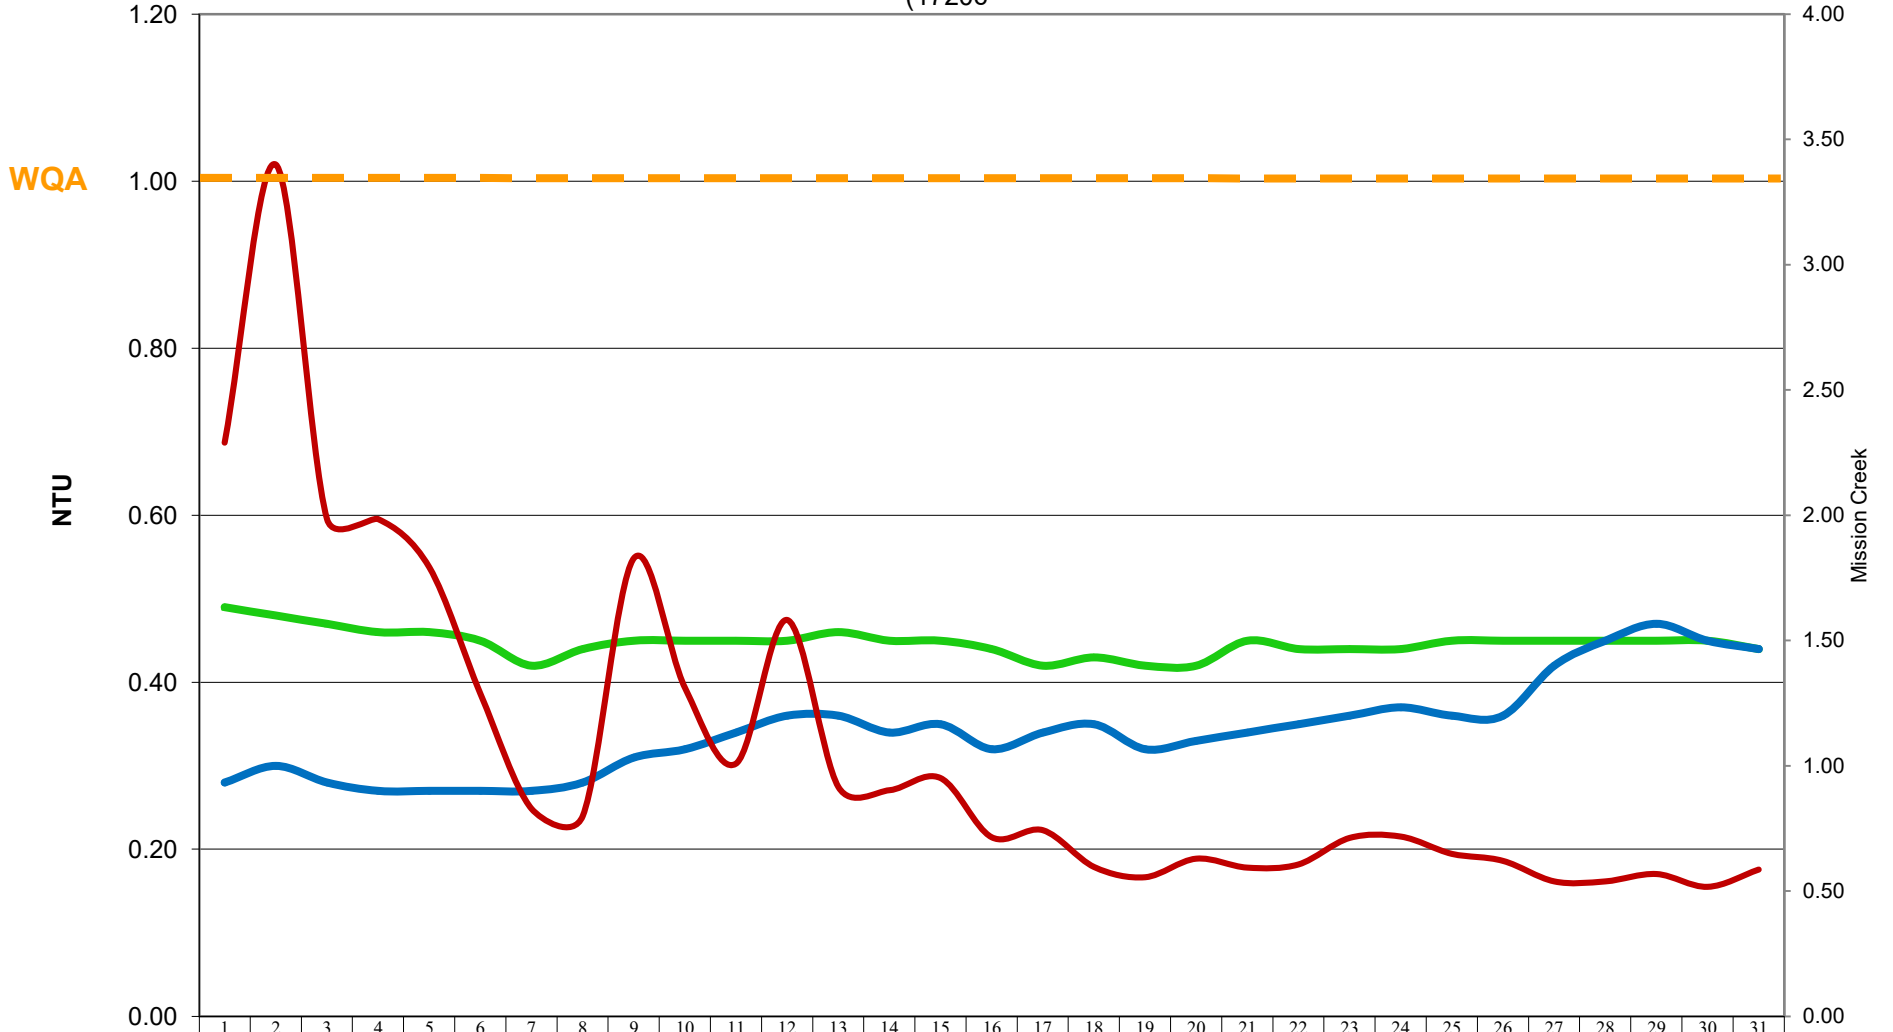

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Distribution Intake	0.49	0.48	0.47	0.46	0.46	0.45	0.42	0.44	0.45	0.45	0.45	0.45	0.46	0.45	0.45	0.44	0.42	0.43	0.42	0.42	0.45	0.44	0.44	0.44	0.45	0.45	0.45	0.45	0.45	0.45	0.44
Booster#1- First User	0.28	0.30	0.28	0.27	0.27	0.27	0.27	0.28	0.31	0.32	0.34	0.36	0.36	0.34	0.35	0.32	0.34	0.35	0.32	0.33	0.34	0.35	0.36	0.37	0.36	0.36	0.42	0.45	0.47	0.45	0.44
Mission Creek Intake	2.29	3.40	1.99	1.99	1.79	1.29	0.83	0.80	1.83	1.31	1.01	1.58	0.92	0.90	0.95	0.72	0.74	0.60	0.56	0.63	0.59	0.61	0.71	0.72	0.65	0.62	0.54	0.54	0.57	0.52	0.59

Date