


# BMID Turbidity July 2022

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

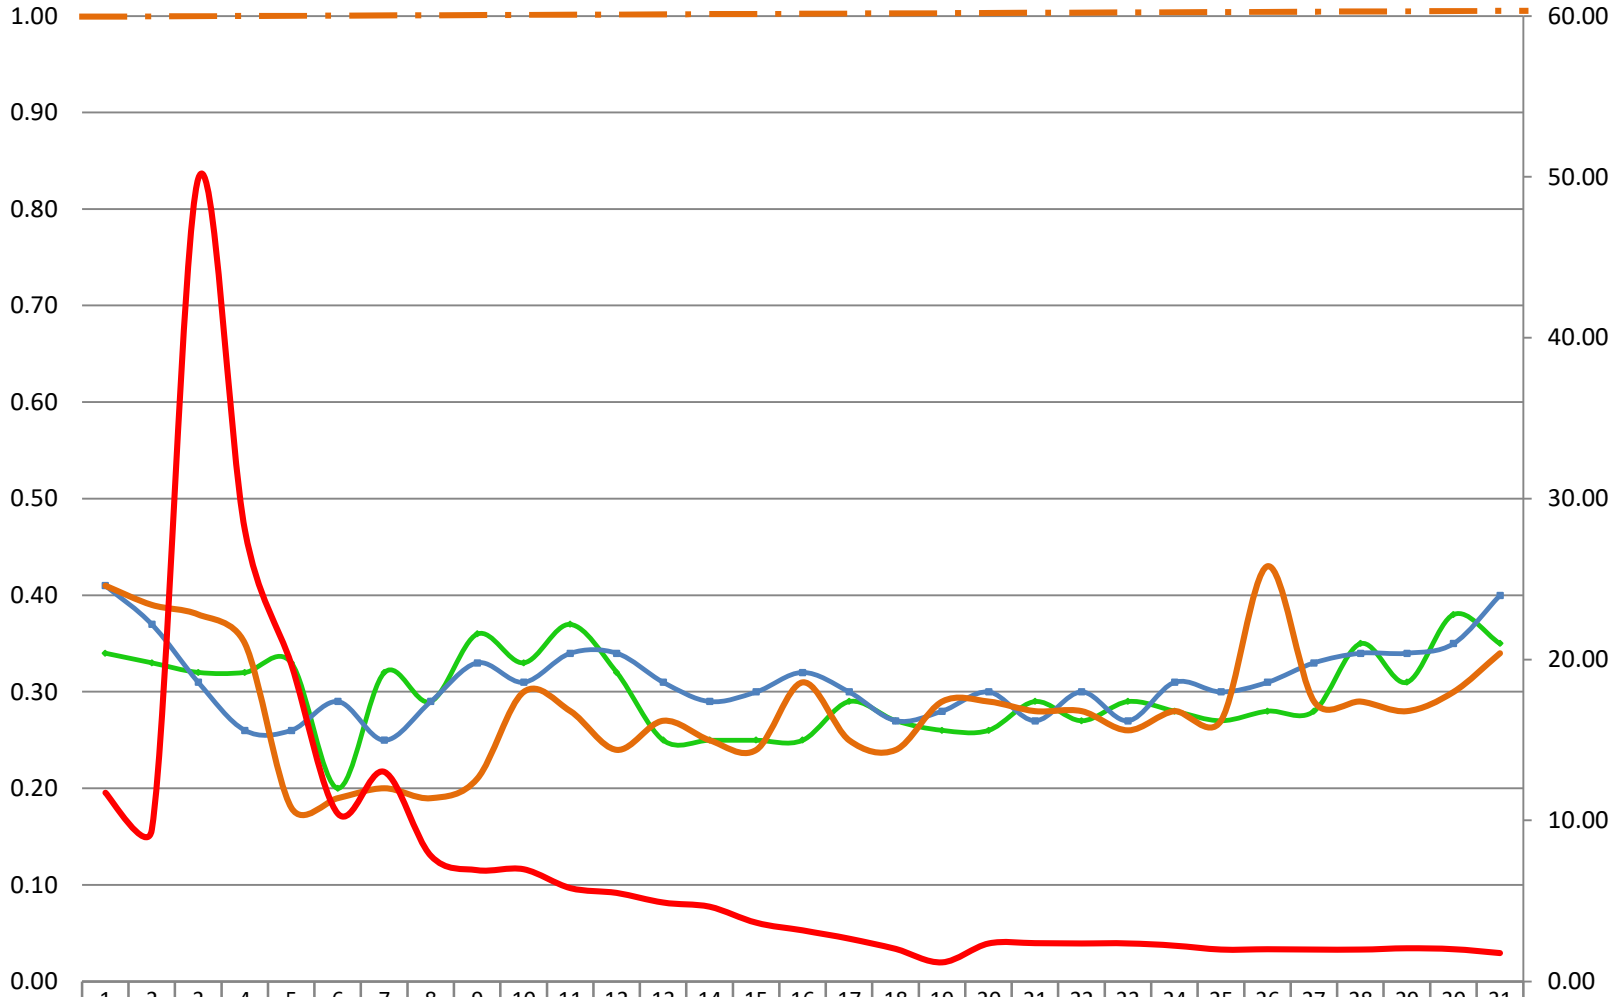

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Distribution Intake	0.34	0.33	0.32	0.32	0.33	0.20	0.32	0.29	0.36	0.33	0.37	0.32	0.25	0.25	0.25	0.25	0.29	0.27	0.26	0.26	0.29	0.27	0.29	0.28	0.27	0.28	0.28	0.35	0.31	0.38	0.35
Booster #1	0.41	0.37	0.31	0.26	0.26	0.29	0.25	0.29	0.33	0.31	0.34	0.34	0.31	0.29	0.30	0.32	0.30	0.27	0.28	0.30	0.27	0.30	0.27	0.31	0.30	0.31	0.33	0.34	0.34	0.35	0.40
UV Plant	0.41	0.39	0.38	0.35	0.18	0.19	0.20	0.19	0.21	0.30	0.28	0.24	0.27	0.25	0.24	0.31	0.25	0.24	0.29	0.29	0.28	0.28	0.26	0.28	0.27	0.43	0.29	0.29	0.28	0.30	0.34
Mission Creek Intake	11.7	9.45	49.8	28.0	19.7	10.4	13.0	7.81	6.91	6.97	5.81	5.50	4.90	4.64	3.65	3.17	2.66	2.02	1.19	2.37	2.38	2.37	2.37	2.23	1.98	2.01	1.98	1.98	2.06	2.01	1.77