


BMID Turbidity August 2022 (Single Point Daily Sampling with Inline Hach 1720c)

WQA

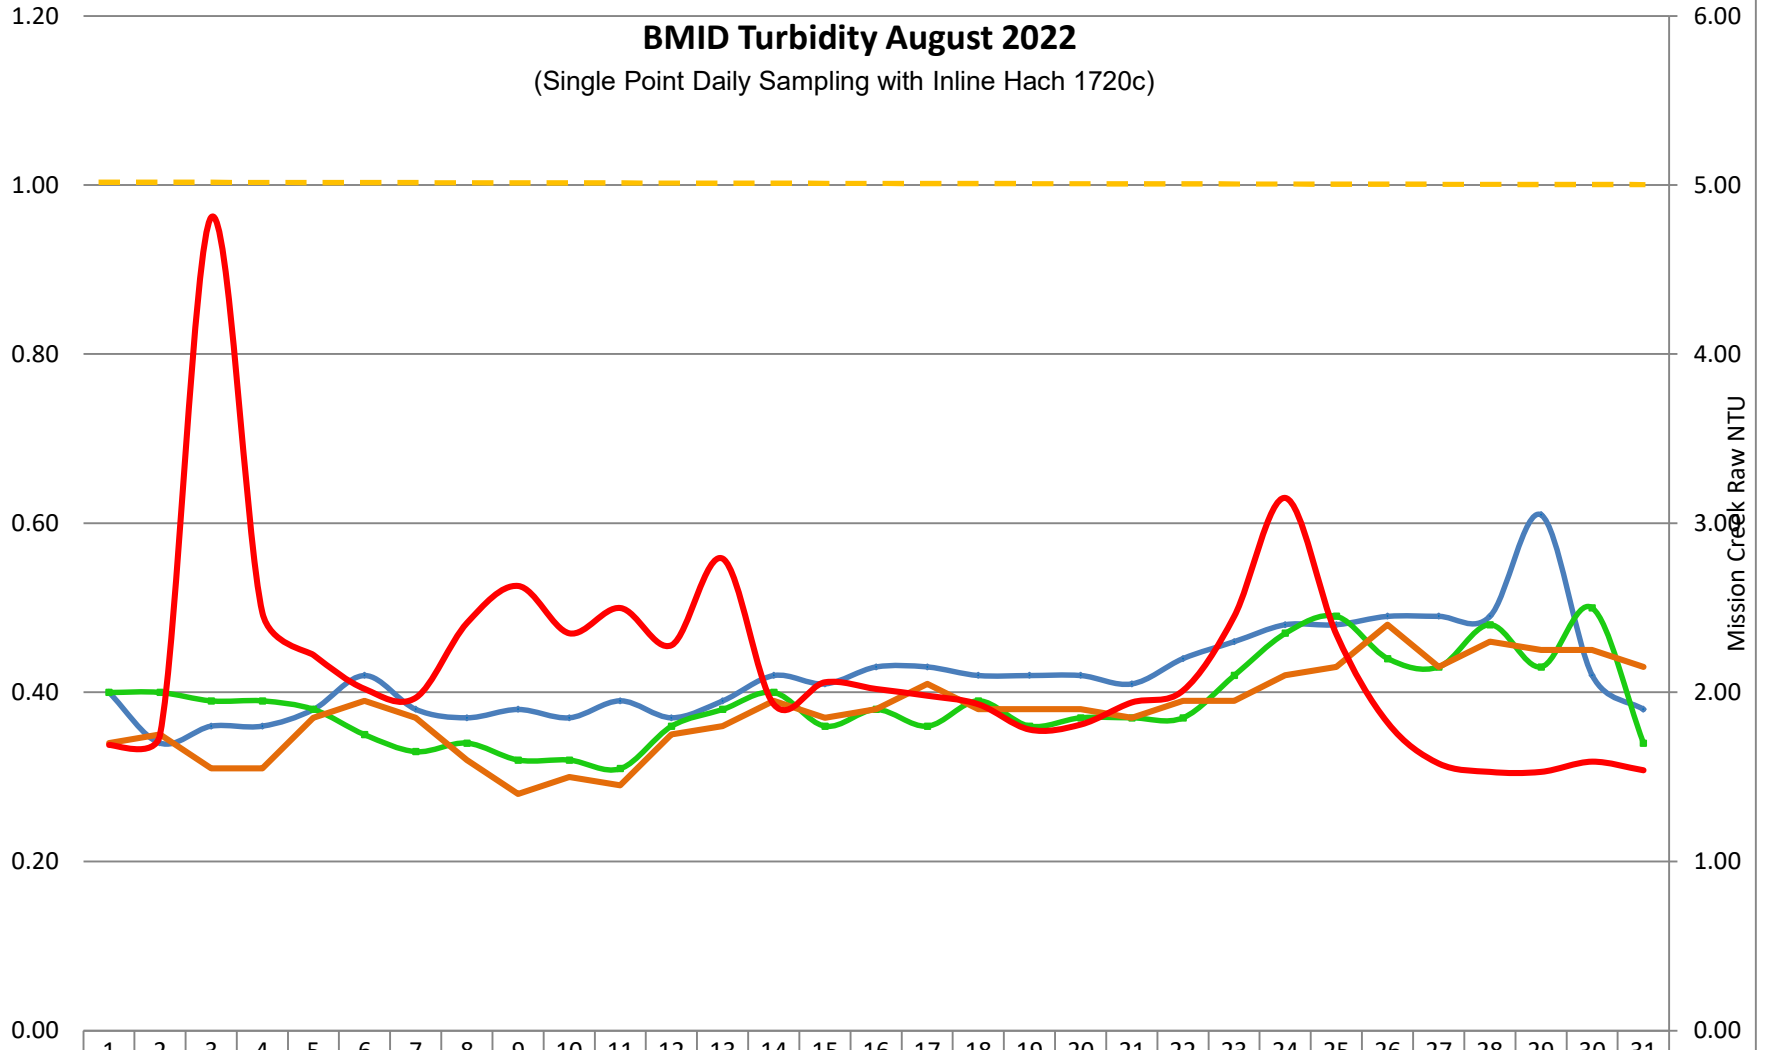

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Distribution Intake	0.4	0.3	0.3	0.3	0.3	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.6	0.4	0.3
Booster#1- First User	0.4	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.5	0.3
UV Plant	0.3	0.4	0.3	0.3	0.4	0.4	0.4	0.3	0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.5	0.4	0.5	0.5	0.5	0.5	0.4
Mission Creek Intake	1.6	1.7	4.8	2.4	2.2	2.0	1.9	2.4	2.6	2.3	2.5	2.2	2.7	1.9	2.0	2.0	1.9	1.9	1.7	1.8	1.9	2.0	2.4	3.1	2.3	1.8	1.5	1.5	1.5	1.5	1.5	