


BMID Turbidity January 2024

Single Point Daily Sampling with Inline)
(Hach 1720c

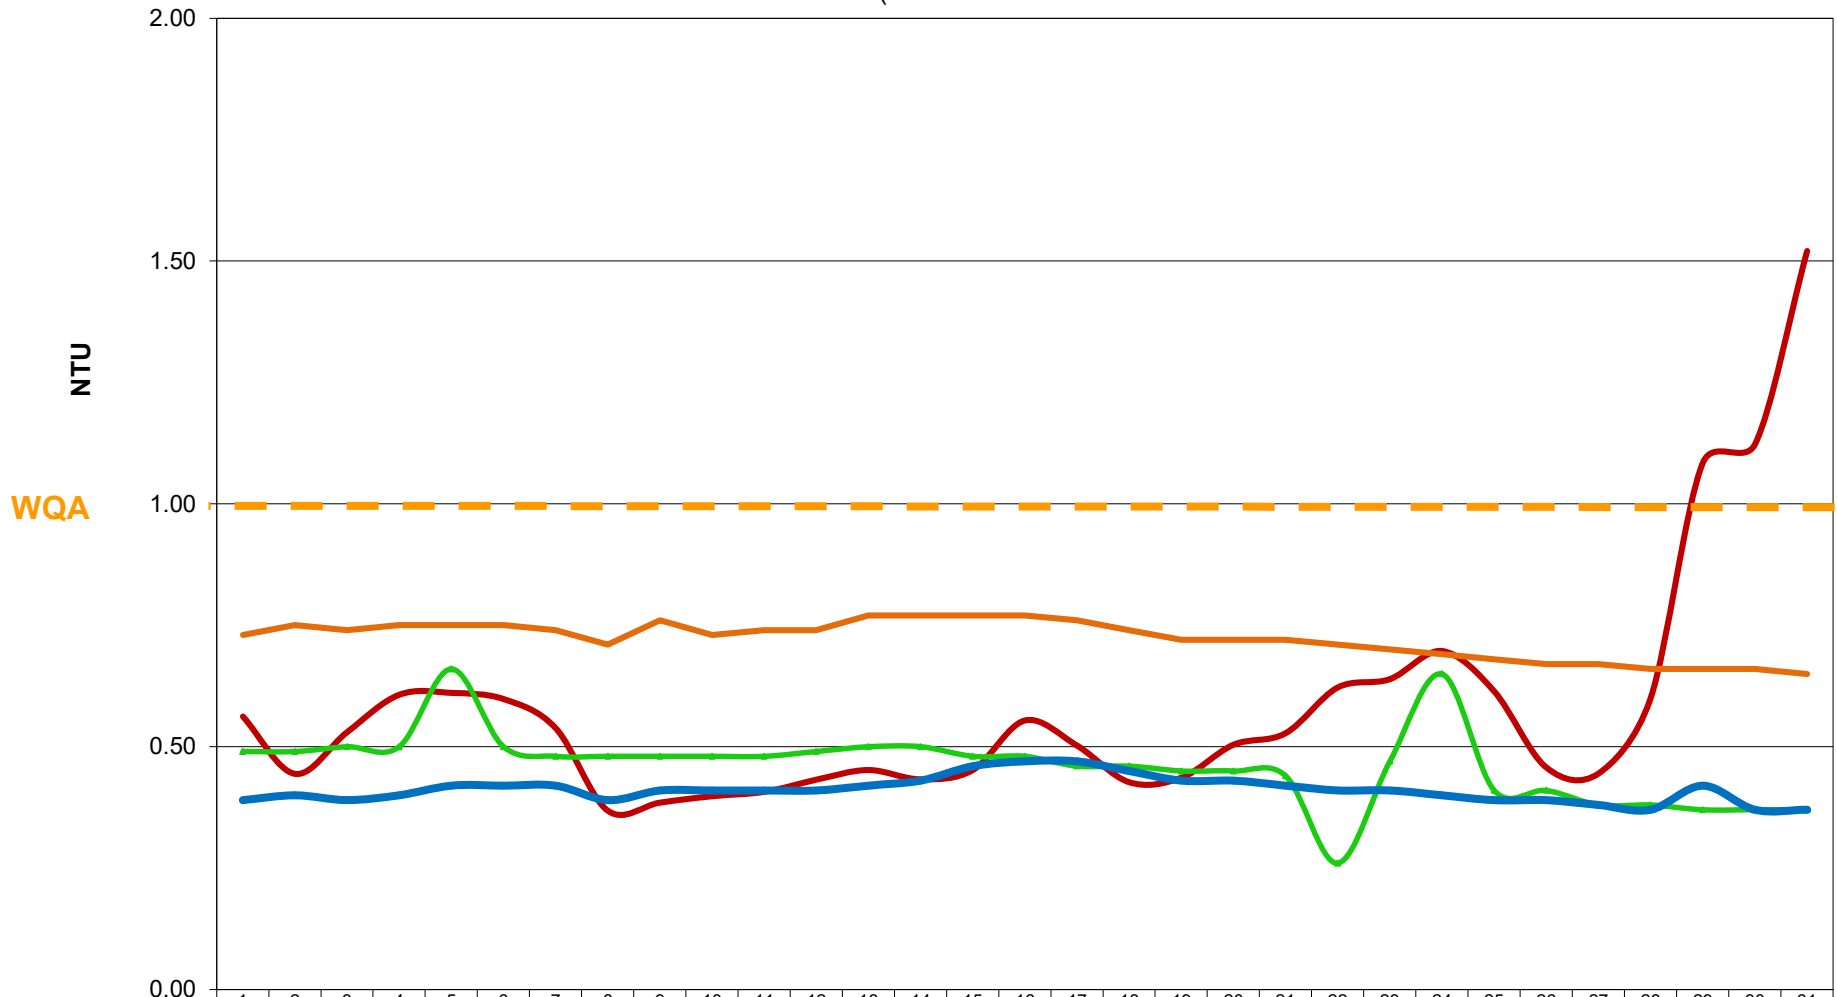

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Mission Creek Intake	0.56	0.44	0.53	0.61	0.61	0.60	0.54	0.37	0.39	0.40	0.41	0.43	0.45	0.43	0.45	0.55	0.50	0.43	0.44	0.50	0.53	0.62	0.64	0.70	0.61	0.46	0.45	0.60	1.09	1.12	1.52
Distribution Intake	0.49	0.49	0.50	0.50	0.66	0.50	0.48	0.48	0.48	0.48	0.48	0.49	0.50	0.50	0.48	0.48	0.46	0.46	0.45	0.45	0.44	0.26	0.47	0.65	0.41	0.41	0.38	0.38	0.37	0.37	0.37
UV Plant	0.73	0.75	0.74	0.75	0.75	0.75	0.74	0.71	0.76	0.73	0.74	0.74	0.77	0.77	0.77	0.77	0.76	0.74	0.72	0.72	0.72	0.71	0.70	0.69	0.68	0.67	0.67	0.66	0.66	0.66	0.65
Booster#1- First User	0.39	0.40	0.39	0.40	0.42	0.42	0.42	0.39	0.41	0.41	0.41	0.41	0.42	0.43	0.46	0.47	0.47	0.45	0.43	0.43	0.42	0.41	0.41	0.40	0.39	0.39	0.38	0.37	0.42	0.37	0.37

Date