


## BMID Turbidity February 2024

(Single Point Daily Sampling with Inline Hach 1720c)

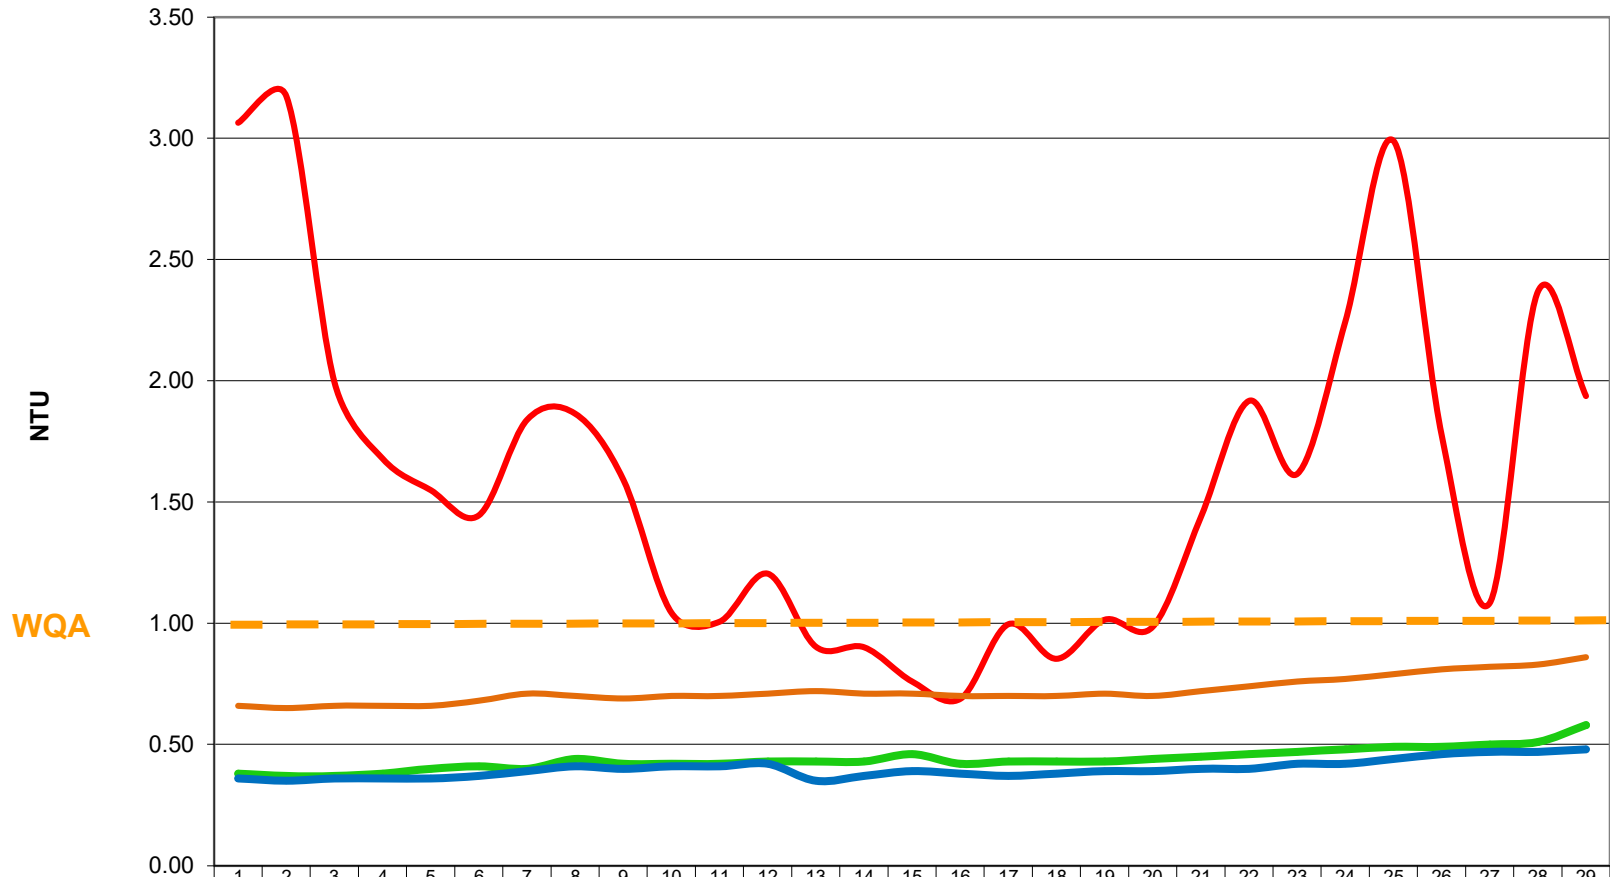

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29
<span style="color: green;">—</span> Distribution Intake	0.38	0.37	0.37	0.38	0.40	0.41	0.40	0.44	0.42	0.42	0.42	0.43	0.43	0.43	0.46	0.42	0.43	0.43	0.43	0.44	0.45	0.46	0.47	0.48	0.49	0.49	0.50	0.51	0.58
<span style="color: blue;">—</span> Booster#1- First User	0.36	0.35	0.36	0.36	0.36	0.37	0.39	0.41	0.40	0.41	0.41	0.42	0.35	0.37	0.39	0.38	0.37	0.38	0.39	0.39	0.40	0.40	0.42	0.42	0.44	0.46	0.47	0.47	0.48
<span style="color: red;">—</span> Mission Creek Intake	3.06	3.17	1.99	1.68	1.55	1.45	1.84	1.87	1.59	1.04	1.01	1.20	0.90	0.90	0.76	0.69	1.00	0.85	1.02	0.99	1.44	1.92	1.62	2.25	2.99	1.78	1.08	2.37	1.94
<span style="color: orange;">—</span> UV Plant	0.66	0.65	0.66	0.66	0.66	0.68	0.71	0.70	0.69	0.70	0.70	0.71	0.72	0.71	0.71	0.70	0.70	0.70	0.71	0.70	0.72	0.74	0.76	0.77	0.79	0.81	0.82	0.83	0.86

**Date**