



CERTIFICATE OF ANALYSIS

REPORTED TO Black Mountain Irrigation District
285 Gray Avenue
KELOWNA, BC V1X 1W8

ATTENTION Robert Hrasko

PO NUMBER
PROJECT Screen Works/ Chemistry
PROJECT INFO

WORK ORDER 24G0384

RECEIVED / TEMP 2024-07-03 11:32 / 17.0°C
REPORTED 2024-07-09 16:07
COC NUMBER No Number

Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO/IEC 17025:2017 for specific tests listed in the scope of accreditation approved by CALA.

Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

Ahead of the Curve



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.

By engaging our services, you are agreeing to CARO Analytical Service's Standard Terms and Conditions outlined here: <https://www.caro.ca/terms-conditions>


If you have any questions or concerns, please contact me at bwhitehead@caro.ca

Authorized By:

Brent Whitehead
Account Manager

1-888-311-8846 | www.caro.ca

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7 | #108 4475 Wayburne Drive Burnaby, BC V5G 4X4

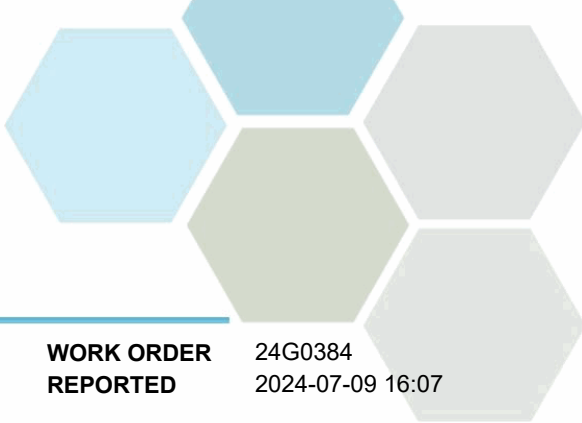

TEST RESULTS


REPORTED TO PROJECT Black Mountain Irrigation District
Screen Works/ Chemistry

WORK ORDER REPORTED 24G0384
2024-07-09 16:07

Analyte	Result	RL	Units	Analyzed	Qualifier
Screenworks (24G0384-01) Matrix: Water Sampled: 2024-07-03 07:52					
<i>Field Parameters</i>					
Chlorine, Free	2.79	0.02	mg/L	2024-07-03	
Temperature, field	16.9		°C	2024-07-03	
<i>General Parameters</i>					
Alkalinity, Total (as CaCO3)	26.2	1.0	mg/L	2024-07-04	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Bicarbonate (as CaCO3)	26.2	1.0	mg/L	2024-07-04	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Colour, True	< 5.0	5.0	CU	2024-07-04	
Conductivity (EC)	81.8	2.0	µS/cm	2024-07-04	
pH	7.90	0.10	pH units	2024-07-04	HT2
Turbidity	0.31	0.10	NTU	2024-07-04	
UV Transmittance @ 254nm	93.2	0.10	% T	2024-07-04	

Well #5 (24G0384-02) | Matrix: Water | Sampled: 2024-07-03 10:24

<i>Anions</i>					
Chloride	15.2	0.10	mg/L	2024-07-04	
Fluoride	0.21	0.10	mg/L	2024-07-04	
Nitrate (as N)	5.21	0.010	mg/L	2024-07-04	
Nitrite (as N)	< 0.010	0.010	mg/L	2024-07-04	
Sulfate	27.2	1.0	mg/L	2024-07-04	
<i>Calculated Parameters</i>					
Hardness, Total (as CaCO3)	259	0.500	mg/L	N/A	
Langelier Index	-0.1	-5.0		2024-07-09	CT10
Solids, Total Dissolved	297	1.00	mg/L	N/A	
<i>Field Parameters</i>					
Chlorine, Free	0.62	0.02	mg/L	2024-07-03	
Temperature, field	11.7		°C	2024-07-03	
<i>General Parameters</i>					
Alkalinity, Total (as CaCO3)	201	1.0	mg/L	2024-07-04	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Bicarbonate (as CaCO3)	201	1.0	mg/L	2024-07-04	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Colour, True	< 5.0	5.0	CU	2024-07-04	
Conductivity (EC)	530	2.0	µS/cm	2024-07-04	
Cyanide, Total	< 0.0020	0.0020	mg/L	2024-07-06	
pH	7.48	0.10	pH units	2024-07-04	HT2
Temperature, at pH	22.2		°C	2024-07-04	HT2

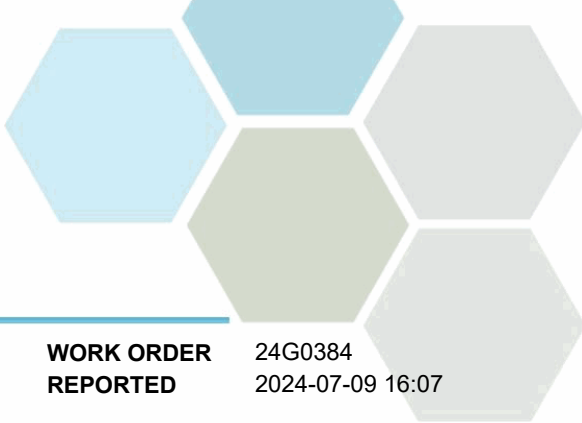

TEST RESULTS

REPORTED TO PROJECT Black Mountain Irrigation District
Screen Works/ Chemistry

WORK ORDER REPORTED 24G0384
2024-07-09 16:07

Analyte	Result	RL	Units	Analyzed	Qualifier
---------	--------	----	-------	----------	-----------

Well #5 (24G0384-02) | Matrix: Water | Sampled: 2024-07-03 10:24, Continued

General Parameters, Continued

Turbidity	< 0.10	0.10	NTU	2024-07-04	
-----------	--------	------	-----	------------	--

Total Metals

Aluminum, total	< 0.0050	0.0050	mg/L	2024-07-06	
Antimony, total	< 0.00020	0.00020	mg/L	2024-07-06	
Arsenic, total	< 0.00050	0.00050	mg/L	2024-07-06	
Barium, total	0.0215	0.0050	mg/L	2024-07-06	
Boron, total	< 0.0500	0.0500	mg/L	2024-07-06	
Cadmium, total	< 0.000010	0.000010	mg/L	2024-07-06	
Calcium, total	78.3	0.20	mg/L	2024-07-06	
Chromium, total	< 0.00050	0.00050	mg/L	2024-07-06	
Cobalt, total	< 0.00010	0.00010	mg/L	2024-07-06	
Copper, total	0.00301	0.00040	mg/L	2024-07-06	
Iron, total	< 0.010	0.010	mg/L	2024-07-06	
Lead, total	< 0.00020	0.00020	mg/L	2024-07-06	
Magnesium, total	15.3	0.010	mg/L	2024-07-06	
Manganese, total	< 0.00020	0.00020	mg/L	2024-07-06	
Mercury, total	< 0.000010	0.000010	mg/L	2024-07-07	
Molybdenum, total	0.00195	0.00010	mg/L	2024-07-06	
Nickel, total	< 0.00040	0.00040	mg/L	2024-07-06	
Potassium, total	2.26	0.10	mg/L	2024-07-06	
Selenium, total	0.00120	0.00050	mg/L	2024-07-06	
Sodium, total	12.5	0.10	mg/L	2024-07-06	
Strontium, total	0.344	0.0010	mg/L	2024-07-06	
Uranium, total	0.00233	0.000020	mg/L	2024-07-06	
Zinc, total	< 0.0040	0.0040	mg/L	2024-07-06	

Pearson School (24G0384-03) | Matrix: Water | Sampled: 2024-07-03 09:16

Anions


Chloride	10.0	0.10	mg/L	2024-07-04	
Fluoride	< 0.10	0.10	mg/L	2024-07-04	
Nitrate (as N)	< 0.010	0.010	mg/L	2024-07-04	
Nitrite (as N)	< 0.010	0.010	mg/L	2024-07-04	
Sulfate	2.2	1.0	mg/L	2024-07-04	

Calculated Parameters

Hardness, Total (as CaCO3)	21.6	0.500	mg/L	N/A	
Langelier Index	-2.6	-5.0		2024-07-09	CT10
Solids, Total Dissolved	43.2	1.00	mg/L	N/A	

Field Parameters

Chlorine, Free	0.68	0.02	mg/L	2024-07-03	
Temperature, field	18.8		°C	2024-07-03	

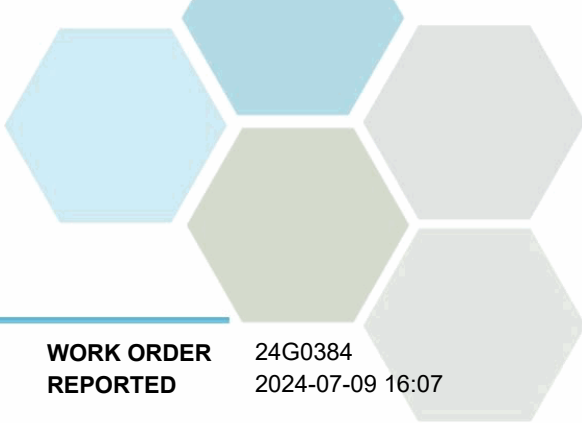

TEST RESULTS

REPORTED TO PROJECT Black Mountain Irrigation District
Screen Works/ Chemistry

WORK ORDER REPORTED 24G0384
2024-07-09 16:07

Analyte	Result	RL	Units	Analyzed	Qualifier
---------	--------	----	-------	----------	-----------

Pearson School (24G0384-03) | Matrix: Water | Sampled: 2024-07-03 09:16, Continued

General Parameters


Alkalinity, Total (as CaCO3)	25.0	1.0	mg/L	2024-07-04	
Alkalinity, Phenolphthalein (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Bicarbonate (as CaCO3)	25.0	1.0	mg/L	2024-07-04	
Alkalinity, Carbonate (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Alkalinity, Hydroxide (as CaCO3)	< 1.0	1.0	mg/L	2024-07-04	
Colour, True	< 5.0	5.0	CU	2024-07-04	
Conductivity (EC)	83.6	2.0	µS/cm	2024-07-04	
Cyanide, Total	< 0.0020	0.0020	mg/L	2024-07-06	
pH	6.79	0.10	pH units	2024-07-04	HT2
Temperature, at pH	22.5		°C	2024-07-04	HT2
Turbidity	0.26	0.10	NTU	2024-07-04	

Total Metals

Aluminum, total	0.215	0.0050	mg/L	2024-07-06	
Antimony, total	< 0.00020	0.00020	mg/L	2024-07-06	
Arsenic, total	< 0.00050	0.00050	mg/L	2024-07-06	
Barium, total	< 0.0050	0.0050	mg/L	2024-07-06	
Boron, total	< 0.0500	0.0500	mg/L	2024-07-06	
Cadmium, total	< 0.000010	0.000010	mg/L	2024-07-06	
Calcium, total	6.43	0.20	mg/L	2024-07-06	
Chromium, total	< 0.00050	0.00050	mg/L	2024-07-06	
Cobalt, total	< 0.00010	0.00010	mg/L	2024-07-06	
Copper, total	0.00122	0.00040	mg/L	2024-07-06	
Iron, total	< 0.010	0.010	mg/L	2024-07-06	
Lead, total	< 0.00020	0.00020	mg/L	2024-07-06	
Magnesium, total	1.35	0.010	mg/L	2024-07-06	
Manganese, total	0.00284	0.00020	mg/L	2024-07-06	
Mercury, total	< 0.000010	0.000010	mg/L	2024-07-07	
Molybdenum, total	0.00030	0.00010	mg/L	2024-07-06	
Nickel, total	< 0.00040	0.00040	mg/L	2024-07-06	
Potassium, total	0.53	0.10	mg/L	2024-07-06	
Selenium, total	< 0.00050	0.00050	mg/L	2024-07-06	
Sodium, total	7.43	0.10	mg/L	2024-07-06	
Strontium, total	0.0361	0.0010	mg/L	2024-07-06	
Uranium, total	0.000038	0.000020	mg/L	2024-07-06	
Zinc, total	< 0.0040	0.0040	mg/L	2024-07-06	

Sample Qualifiers:

- CT10 Results were based on lab pH.
- HT2 The 15 minute recommended holding time (from sampling to analysis) has been exceeded - field analysis is recommended.

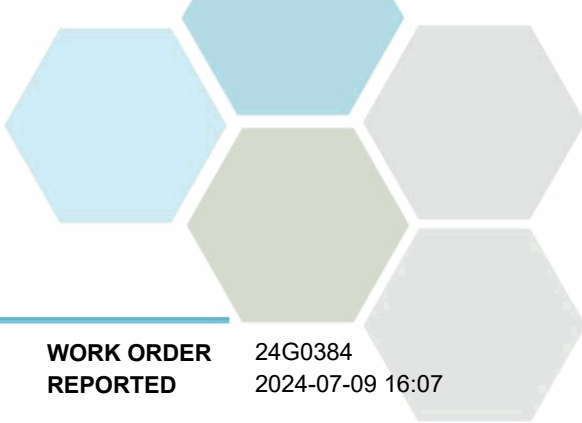

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Black Mountain Irrigation District
Screen Works/ Chemistry


WORK ORDER REPORTED 24G0384
2024-07-09 16:07

Analysis Description	Method Ref.	Technique	Accredited	Location
Alkalinity in Water	SM 2320 B* (2021)	Titration with H2SO4	✓	Kelowna
Anions in Water	SM 4110 B (2020)	Ion Chromatography	✓	Kelowna
Colour, True in Water	SM 2120 C (2021)	Spectrophotometry (456 nm)	✓	Kelowna
Conductivity in Water	SM 2510 B (2021)	Conductivity Meter	✓	Kelowna
Cyanide, SAD in Water	ASTM D7511-12	Flow Injection with In-Line UV Digestion and Amperometry	✓	Kelowna
Hardness in Water	SM 2340 B* (2021)	Calculation: 2.497 [total Ca] + 4.118 [total Mg] (Est)	✓	N/A
Langelier Index in Water	SM 2330 B (2021)	Calculation		N/A
Mercury, total in Water	EPA 245.7*	BrCl2 Oxidation / Cold Vapor Atomic Fluorescence Spectrometry (CVAFS)	✓	Richmond
pH in Water	SM 4500-H+ B (2021)	Electrometry	✓	Kelowna
Solids, Total Dissolved in Water	SM 1030 E (2021)	SM 1030 E		N/A
Total Metals in Water	EPA 200.2 / EPA 6020B	HNO3+HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	✓	Richmond
Transmittance at 254 nm in Water	SM 5910 B* (2021)	Ultraviolet Absorption	✓	Kelowna
Turbidity in Water	SM 2130 B (2020)	Nephelometry	✓	Kelowna

Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method

Glossary of Terms:

RL	Reporting Limit (default)
% T	Percent Transmittance
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
°C	Degrees Celcius
CU	Colour Units (referenced against a platinum cobalt standard)
mg/L	Milligrams per litre
NTU	Nephelometric Turbidity Units
pH units	pH < 7 = acidic, pH > 7 = basic
µS/cm	Microsiemens per centimetre
ASTM	ASTM International Test Methods
EPA	United States Environmental Protection Agency Test Methods
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

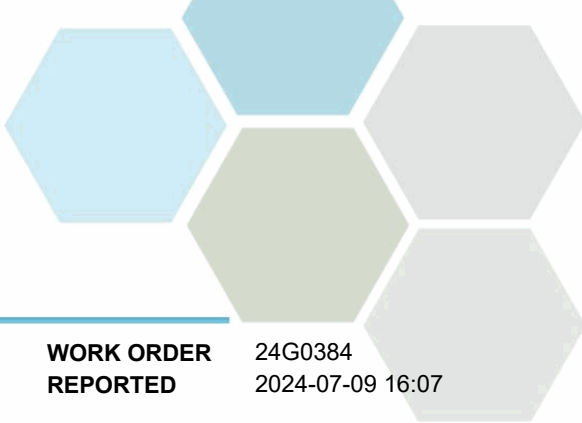

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT Black Mountain Irrigation District
Screen Works/ Chemistry

WORK ORDER REPORTED 24G0384
2024-07-09 16:07

General Comments:

The results in this report apply to the received samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Caro will dispose of all samples within 30 days of sample receipt, unless otherwise agreed. The quality control (QC) data is available upon request

Please note any regulatory guidelines applied to this report are added as a convenience to the client, at their request, to help provide some initial context to analytical results obtained. Although CARO makes every effort to ensure accuracy of the associated regulatory guideline(s) applied, the guidelines applied cannot be assumed to be correct due to a variety of factors and as such CARO Analytical Services assumes no liability or responsibility for the use of those guidelines to make any decisions. The original source of the regulation should be verified and a review of the guideline(s) should be validated as correct in order to make any decisions arising from the comparison of the analytical data obtained to the relevant regulatory guideline for one's particular circumstances. Further, CARO Analytical Services assumes no liability or responsibility for any loss attributed from the use of these guidelines in any way.