


### BMID Turbidity July 2024

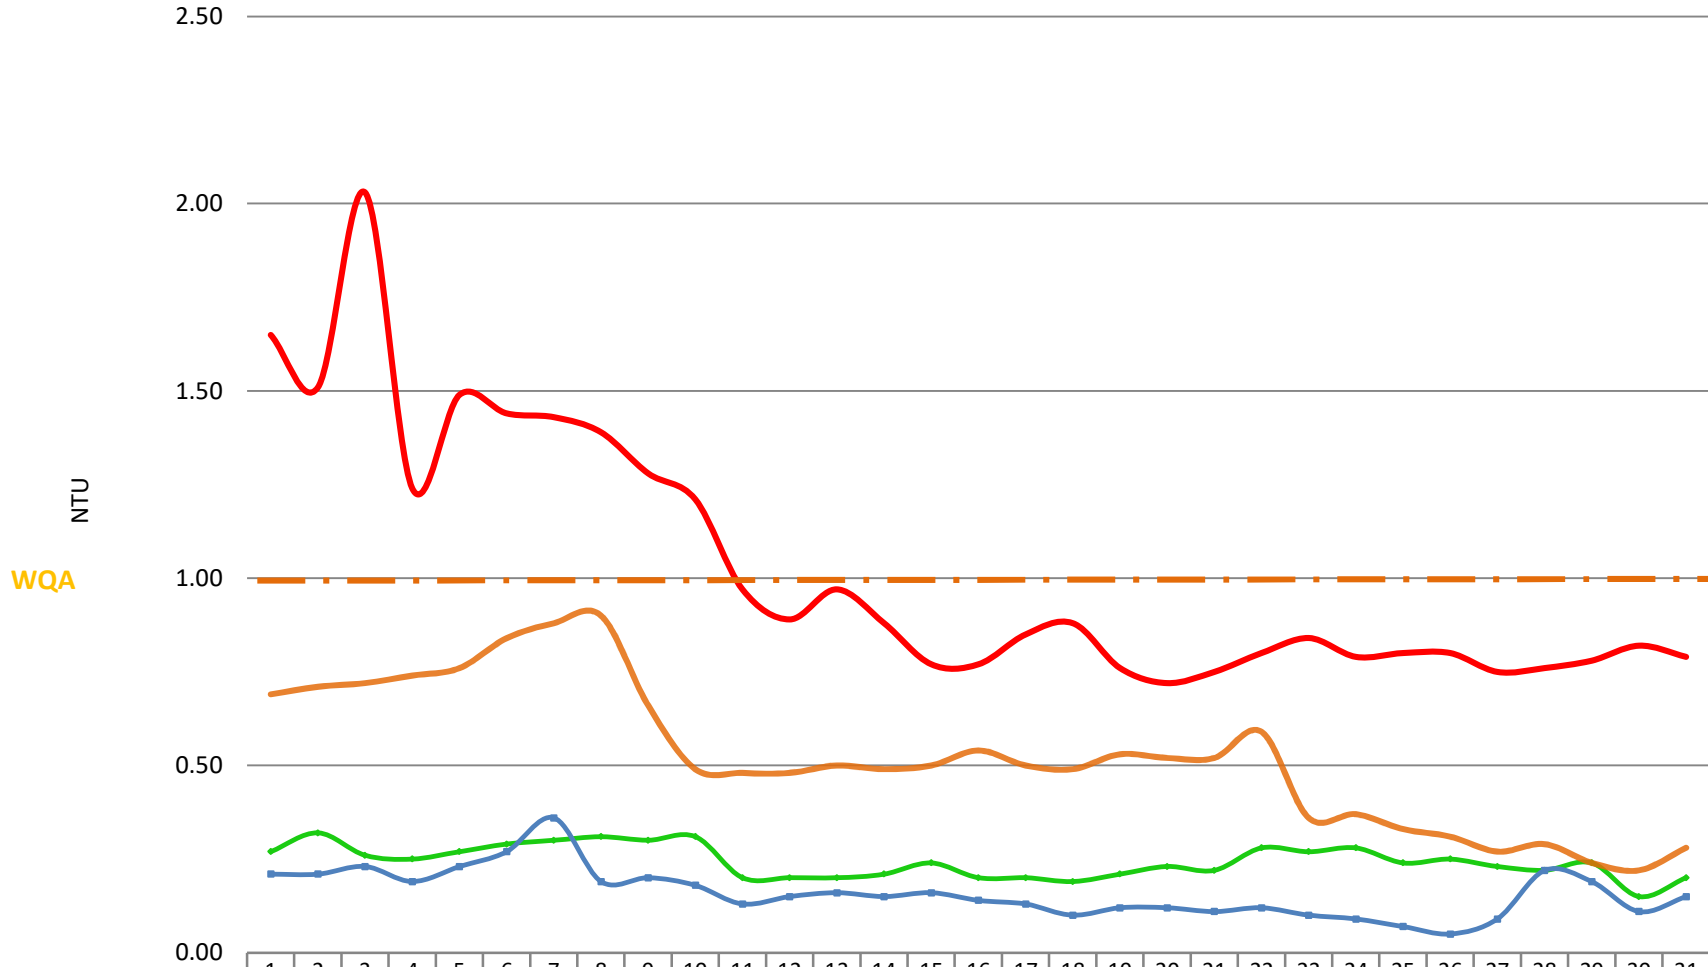

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Distribution Intake	0.2	0.3	0.2	0.2	0.2	0.2	0.3	0.3	0.3	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.1	0.2	
Booster #1	0.2	0.2	0.2	0.1	0.2	0.2	0.3	0.1	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.1	
Mission Creek Intake	1.6	1.5	2.0	1.2	1.4	1.4	1.4	1.3	1.2	1.2	0.9	0.8	0.9	0.8	0.7	0.7	0.8	0.8	0.7	0.7	0.7	0.8	0.8	0.7	0.8	0.8	0.7	0.7	0.7	0.7	0.8	0.7
UV Plant	0.6	0.7	0.7	0.7	0.7	0.8	0.8	0.9	0.6	0.4	0.4	0.4	0.5	0.4	0.5	0.5	0.5	0.4	0.5	0.5	0.5	0.5	0.3	0.3	0.3	0.3	0.2	0.2	0.2	0.2	0.2	