


BMID Turbidity January 2025

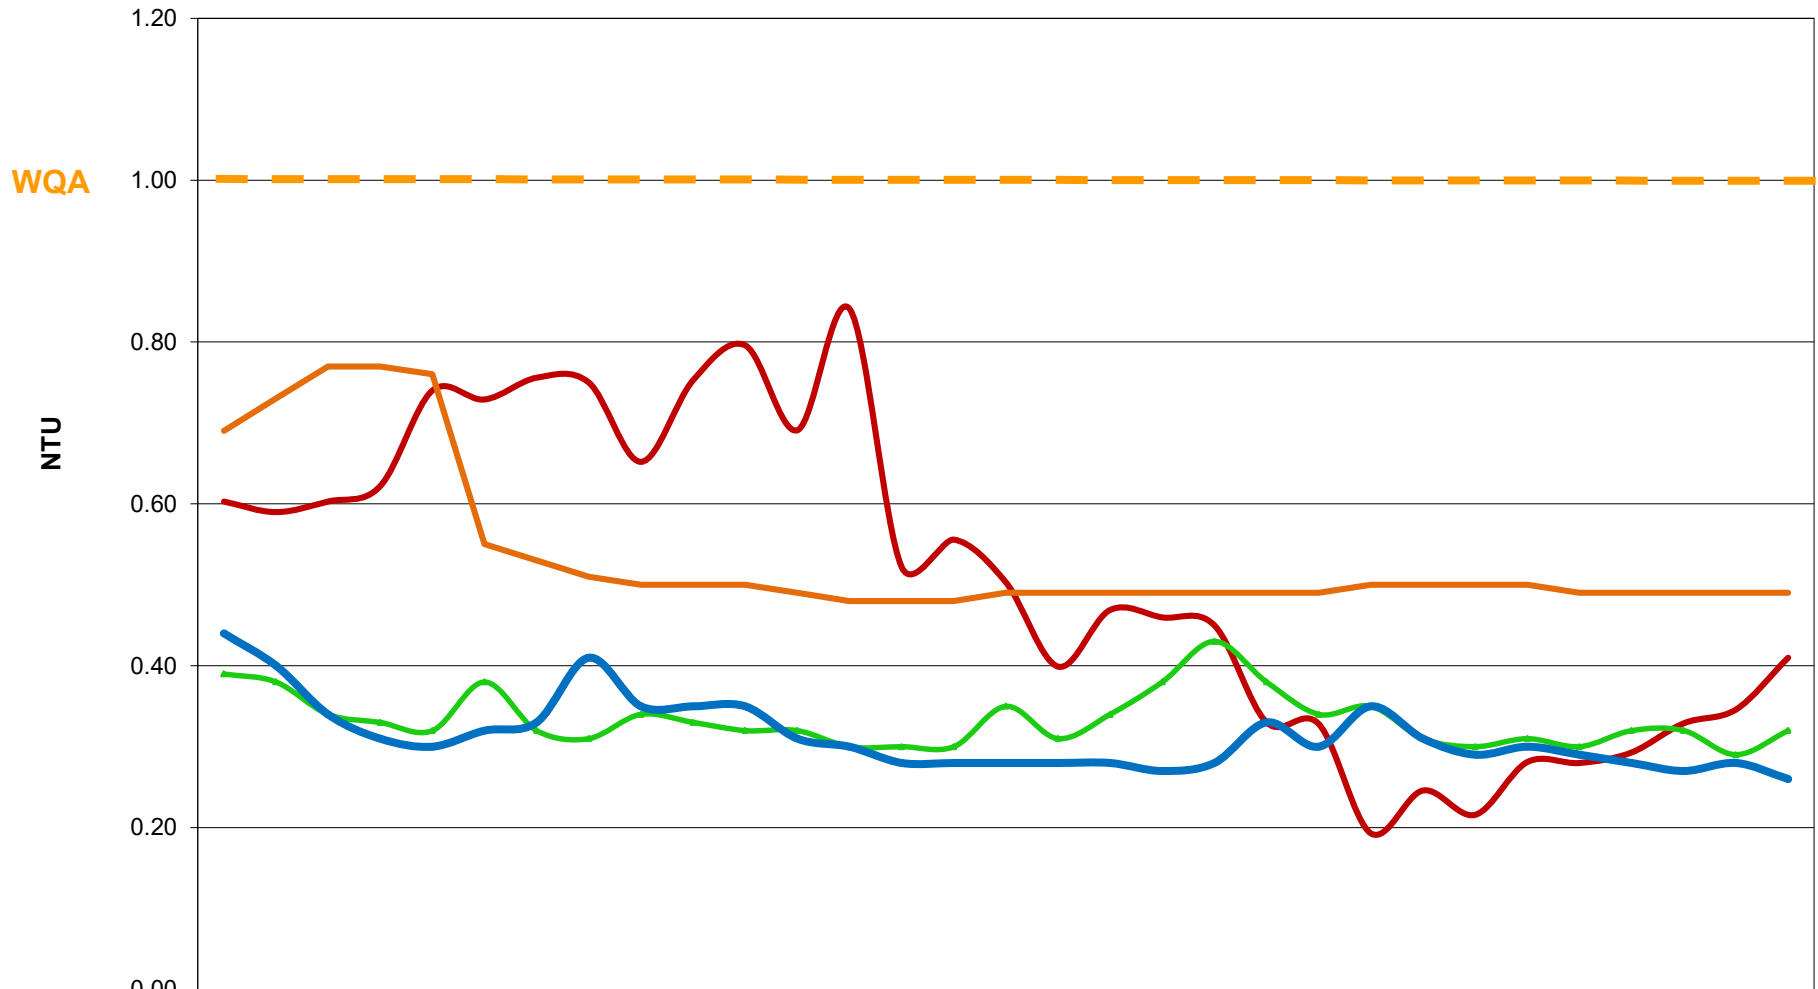

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Mission Creek Intake	0.60	0.59	0.60	0.62	0.74	0.73	0.76	0.75	0.65	0.75	0.80	0.69	0.84	0.52	0.56	0.50	0.40	0.47	0.46	0.45	0.33	0.33	0.19	0.25	0.22	0.28	0.28	0.29	0.33	0.35	0.41
Distribution Intake	0.39	0.38	0.34	0.33	0.32	0.38	0.32	0.31	0.34	0.33	0.32	0.32	0.30	0.30	0.30	0.35	0.31	0.34	0.38	0.43	0.38	0.34	0.35	0.31	0.30	0.31	0.30	0.32	0.32	0.29	0.32
UV Plant	0.69	0.73	0.77	0.77	0.76	0.55	0.53	0.51	0.50	0.50	0.50	0.49	0.48	0.48	0.48	0.49	0.49	0.49	0.49	0.49	0.49	0.49	0.49	0.50	0.50	0.50	0.50	0.49	0.49	0.49	0.49
Booster#1- First User	0.44	0.40	0.34	0.31	0.30	0.32	0.33	0.41	0.35	0.35	0.35	0.31	0.30	0.28	0.28	0.28	0.28	0.28	0.27	0.28	0.33	0.30	0.35	0.31	0.29	0.30	0.29	0.28	0.27	0.28	0.26

Date