


BMID Turbidity October 2025

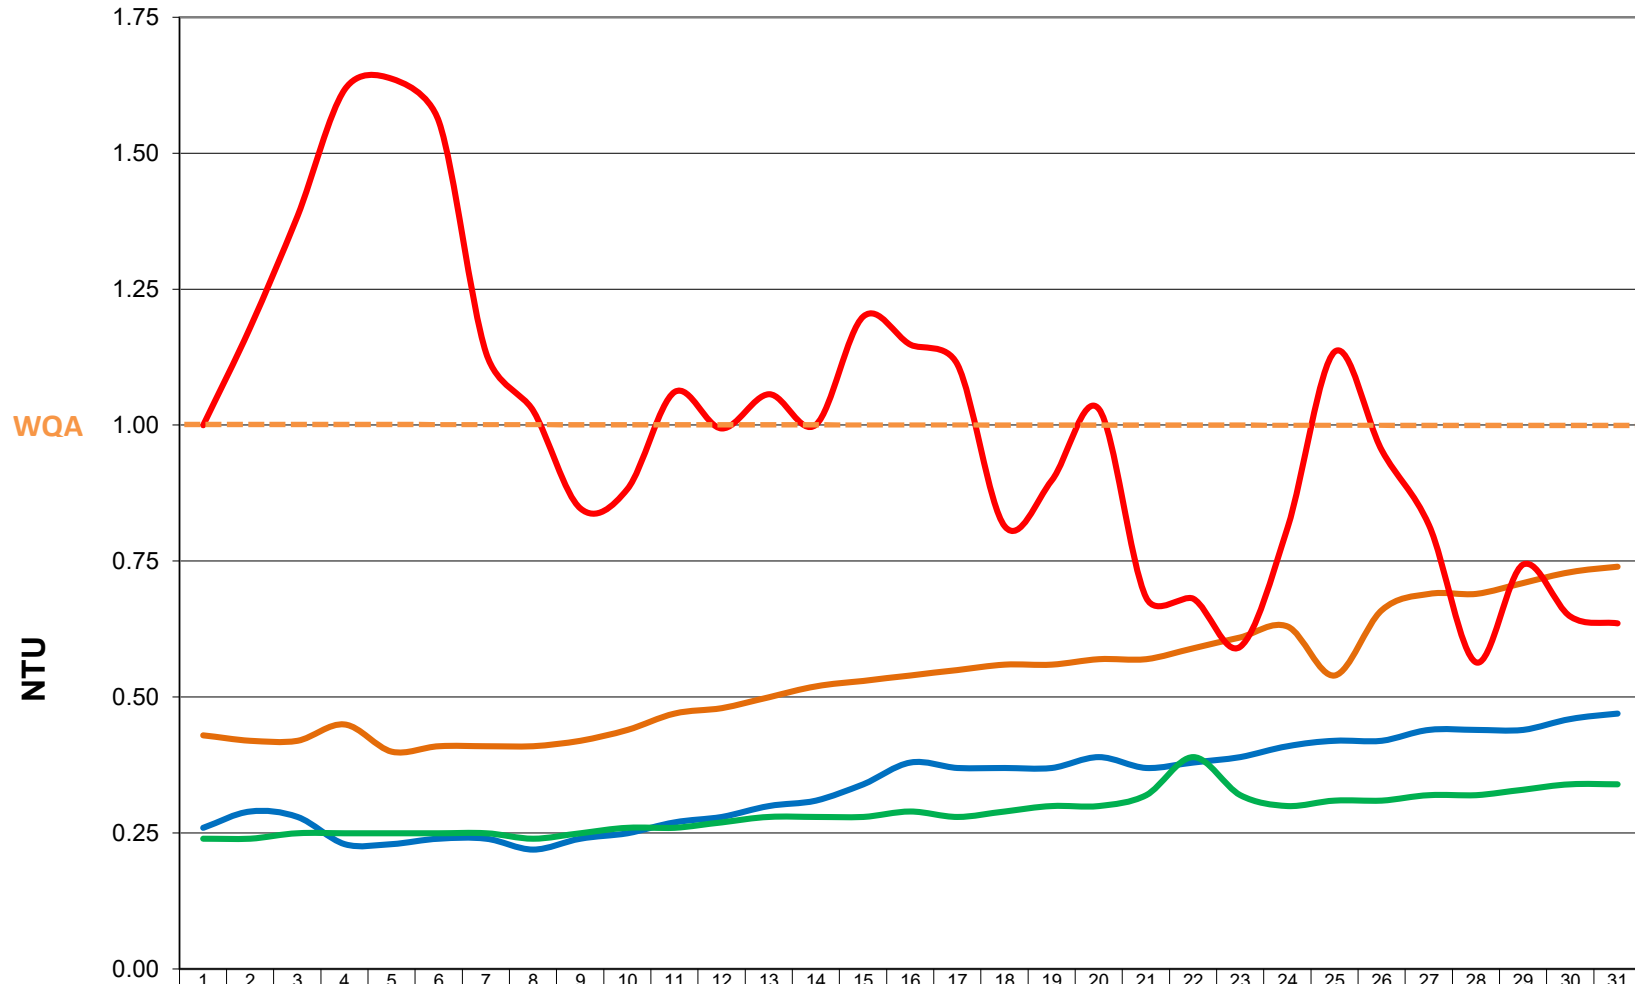

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Booster#1- First User	0.26	0.29	0.28	0.23	0.23	0.24	0.24	0.22	0.24	0.25	0.27	0.28	0.30	0.31	0.34	0.38	0.37	0.37	0.37	0.39	0.37	0.38	0.39	0.41	0.42	0.42	0.44	0.44	0.44	0.46	0.47
Distribution Intake UV Plant Booster#1- First User	0.24	0.24	0.25	0.25	0.25	0.25	0.25	0.24	0.25	0.26	0.26	0.27	0.28	0.28	0.28	0.29	0.28	0.29	0.30	0.30	0.32	0.39	0.32	0.30	0.31	0.31	0.32	0.32	0.33	0.34	0.34
UV Plant	0.43	0.42	0.42	0.45	0.40	0.41	0.41	0.41	0.42	0.44	0.47	0.48	0.50	0.52	0.53	0.54	0.55	0.56	0.56	0.57	0.57	0.59	0.61	0.63	0.54	0.66	0.69	0.69	0.71	0.73	0.74
Mission Creek Intake	1.00	1.18	1.39	1.62	1.64	1.56	1.13	1.03	0.85	0.88	1.06	0.99	1.06	1.00	1.20	1.15	1.11	0.81	0.90	1.03	0.68	0.68	0.59	0.81	1.14	0.95	0.82	0.56	0.74	0.65	0.64

Date