


Black Mountain Irrigation District Turbidity Monitoring

BMID Turbidity July 2014

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

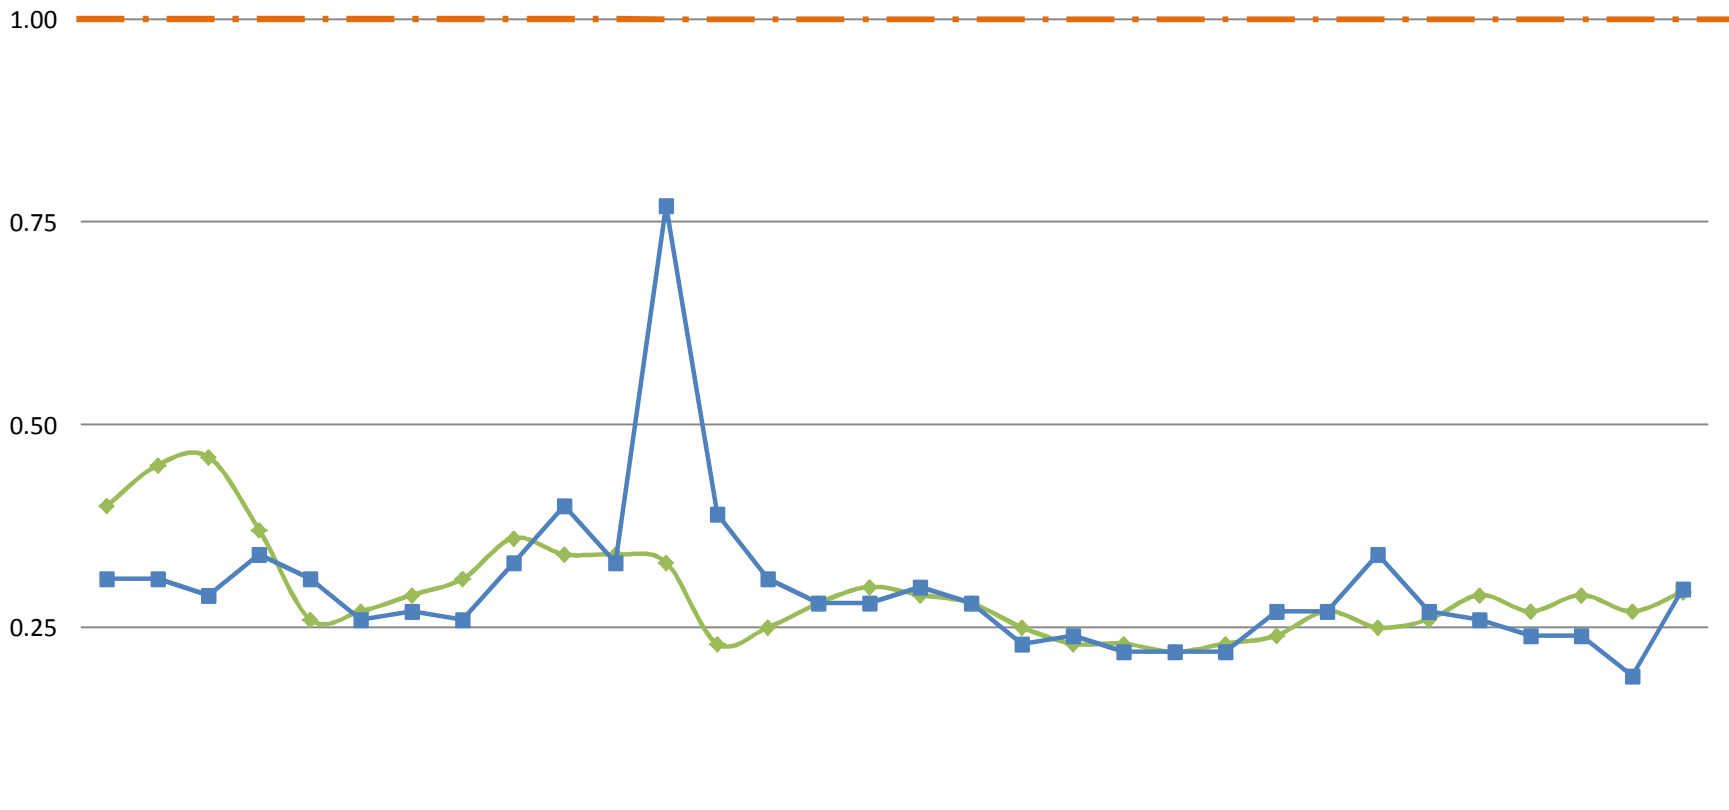

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	Average
Intake	0.40	0.45	0.46	0.37	0.26	0.27	0.29	0.31	0.36	0.34	0.34	0.33	0.23	0.25	0.28	0.30	0.29	0.28	0.25	0.23	0.23	0.22	0.23	0.24	0.27	0.25	0.26	0.29	0.27	0.29	0.27	0.29
Booster #1	0.31	0.31	0.29	0.34	0.31	0.26	0.27	0.26	0.33	0.40	0.33	0.77	0.39	0.31	0.28	0.28	0.30	0.28	0.23	0.24	0.22	0.22	0.22	0.27	0.27	0.34	0.27	0.26	0.24	0.24	0.19	0.30

◆ Intake ■ Booster #1