


Black Mountain Irrigation District Turbidity Monitoring

BMID Turbidity July 2016

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

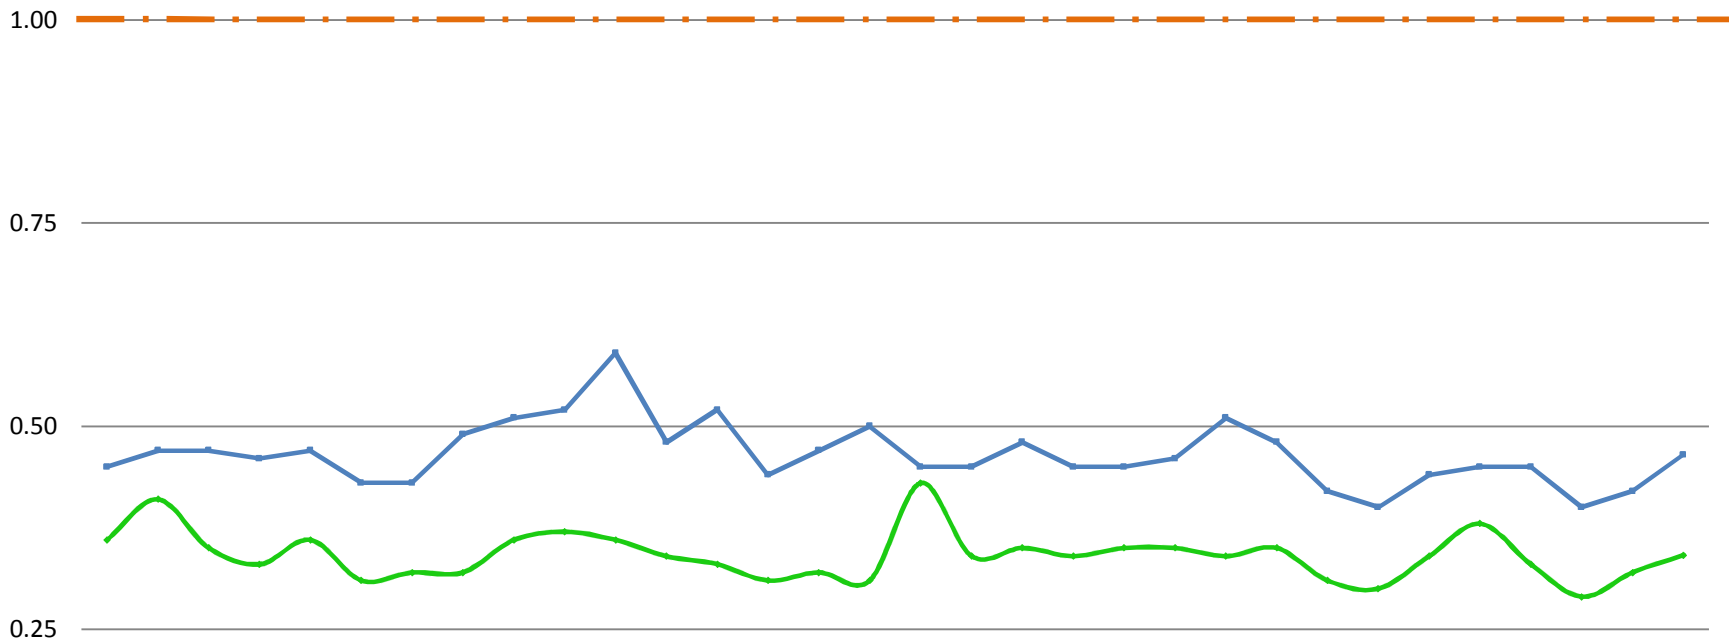

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	AVG
Intake	0.36	0.41	0.35	0.33	0.36	0.31	0.32	0.32	0.36	0.37	0.36	0.34	0.33	0.31	0.32	0.31	0.43	0.34	0.35	0.34	0.35	0.35	0.34	0.35	0.31	0.30	0.34	0.38	0.33	0.29	0.32	0.34
Booster#1- First User	0.45	0.47	0.47	0.46	0.47	0.43	0.43	0.49	0.51	0.52	0.59	0.48	0.52	0.44	0.47	0.50	0.45	0.45	0.48	0.45	0.45	0.46	0.51	0.48	0.42	0.40	0.44	0.45	0.45	0.40	0.42	0.46

—●— Intake
 —●— Booster#1- First User