


# Black Mountain Irrigation District Turbidity Monitoring

## BMID Turbidity July 2017

(Single Point Daily Sampling with Inline Hach 1720c)

**WQA**

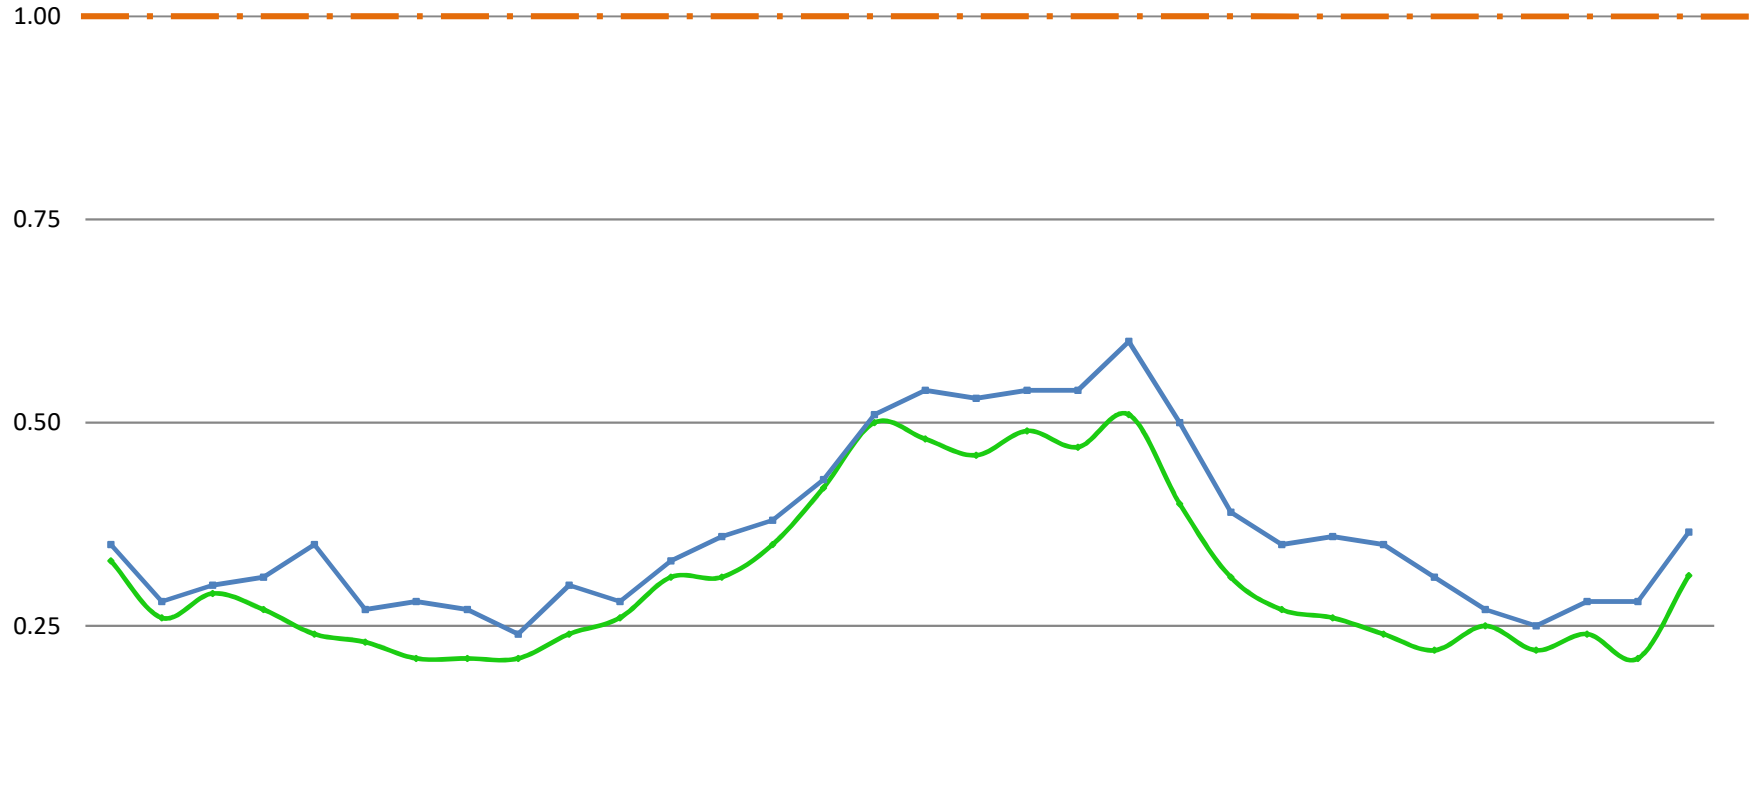

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	AVG
Intake	0.33	0.26	0.29	0.27	0.24	0.23	0.21	0.21	0.21	0.24	0.26	0.31	0.31	0.35	0.42	0.50	0.48	0.46	0.49	0.47	0.51	0.40	0.31	0.27	0.26	0.24	0.22	0.25	0.22	0.24	0.21	0.31
Booster#1- First User	0.35	0.28	0.30	0.31	0.35	0.27	0.28	0.27	0.24	0.30	0.28	0.33	0.36	0.38	0.43	0.51	0.54	0.53	0.54	0.54	0.60	0.50	0.39	0.35	0.36	0.35	0.31	0.27	0.25	0.28	0.28	0.37

—●— Intake    
 —●— Booster#1- First User